

The GGF recommends you always use a GGF Member.
This publication is used by GGF Members and non-Member companies. To see a current list of GGF Members visit www.ggf.org.uk/directory



Glass and Glazing Federation

INDUSTRY INFORMATION
ISSUE 4
SUMMER 2018

Glass and Glazing Federation

A Guide to Best Practice in the Specification and Use of Fire-Resistant Glazed Systems

07 Introduction	14 SECTION 1 Principles	26 SECTION 2 Evidence of Fire Performance	31 SECTION 3 Fire-Resistant Glass
35 SECTION 4 Fire-Resistant Glazing Seals	38 SECTION 5 Timber Screens and Doors	46 SECTION 6 Metal Systems for Screens and Doors	52 SECTION 7 Butt-jointed Systems
54 SECTION 8 Fire-Resistant Glass Floors	58 SECTION 9 Replacement of Fire-Resistant Glazing	63 SECTION 10 Upgrading	67 SECTION 11 Frequently Asked Questions
71 APPENDIX A Membership of the Fire-Resistant Glazing Group	72 APPENDIX B Summary of Impact Safety Requirements	74 APPENDIX C Requirements of Glazing Manifestation	75 APPENDIX D Contact details of Associated Organisations

Contents

Introduction

Introduction by Chairman
 Terms used in this Best Practice Guide
 A quick reference guide to the key factors to be considered in specifying fire-resistant glazing and appointing a glazing contractor
 Reference to principle Building Regulations:
 England and Wales
 Scotland
 Northern Ireland
 Codes of Practice and Standards
 Key points of Best Practice

Section 1 - Principles

Design flexibility
 Planning
 New build
 Building refurbishment
 Upgrade or replacement
 Fire-resistant glazing systems
 Responsibilities
 Glossary of terms
 Applications
 Applicable standards for fire-resistance
 Regulations covering fire safety
 Classification of fire-resistance in UK building regulations
 Approved Document B (England and Wales)
 Regulatory Reform (Fire Safety) Order 2005
 Building Regulation 38 (formerly 16B)
 Classification of fire-resistance to harmonised European Norms
 Property protection – Principles
 Reaction in the Event of Fire

Section 2 - Evidence of Fire Performance

Introduction
 Test Reports
 Assessment reports
 CE marking
 Third-party certificates
 Alternative routes to demonstrate fire-resistance performance
 EC Certificate of conformity

Classification report
 EC Declaration of conformity
 Field of application
 CE marking and harmonised product standards
 Table of Contents continued:

Section 3 - Fire-Resistant Glass

Glass types
 Performance in the event of fire
 Fire-resistant insulating glass units
 Horizontal and sloped glazing systems
 Decorative treatments on glass
 Combining other performance requirements with fire-resisting glazing

Section 4 - Fire-Resistant Glazing Seals

Importance of the glazing seal
 Function of the glazing seal
 Available forms of seals
 Intumescent seal types
 Seal combinations with different glass types
 Non-intumescent seal types

Section 5 - Timber Screens and Doors

Behaviour of timber in fire
 Timber density
 Particular considerations concerning timber fire doors
 Timber glazing beads
 Examples of timber bead types and intumescent seals
 Additional information
 Bead fixings
 Setting blocks
 Integrity and insulation glazing in timber fire-resistant systems
 Glazing apertures in doors
 Particular considerations for 60 minute fire doors
 Linings for glazed apertures in timber doors
 Particular considerations to achieve 60 minute integrity
 Fanlights
 Timber system/trade names
 Steel
 Metal fire doors

Contents

Section 6 - Metal Systems for Screens and Doors

- Behaviour of metal in fire
- Metal screens
- Aluminium
- Composite systems
- Beads and fixings
- Glazing seals for metal framed systems
- Edge cover requirements
- Key factors affecting performance
- Metal system/trade names
- Insulation
- Pressure glazed systems
- Frames for external applications
- Curtain walling systems

Section 7 - Frameless (butt-jointed) Systems

- Types of systems
- Perimeter framing
- Available systems
- Butt-jointed system/trade names

Section 8 - Fire-Resistant Glass Floors

- Essential requirements
- Fire performance requirements and testing
- In service functional requirements
- Additional functional considerations
- Systems
- Connections and gaskets
- External load-bearing fire-resistant floors
- Installation

Section 9 - Replacement of Fire-Resistant Glazing

- Refurbishment of fire-resistant glazed doors and screens
- Recommended best practice
- Glass
- Timber doors
- Glazing seals
- Timber screens
- Steel doors and screens
- Protected buildings and historical context

- Replacement glazing in doors, frames and screens manufactured from materials other than timber or steel

- Marking of fire-resistant glass
- Supporting construction
- Maintenance and aftercare
- Fire stopping
- Storage and transport of fire-resistant glass
- Records and documentation

Section 10 - Upgrading

- Introduction
- Structure
- Timber frames
- Timber glazing beads
- Steel frames
- Integrity only
- Integrity and insulation
- Glazing seals
- Glass
- Glazing

Section 11 - Frequently Asked Questions

Appendix A - Membership of FRGG

Appendix B - Summary of Impact Safety Requirements

Appendix C - Requirements of Glazing Manifestation

Appendix D - Contact details of Associated Organisations

Disclaimer

Message from the Chairman of the Fire-Resistant Glazing Group

Protecting the built environment from fire risk has frequently been in the national press lately and through the Fire-Resistant Glazing Group (FRGG), the Glass and Glazing Federation (GGF) has been updating this best-practice guide. Recent events highlight the need for a comprehensive guide to assist in the specification, testing and use of fire-resistant glazed systems.

We continue to provide information and expertise to the whole construction industry so that correctly specified, tested and installed fire-resistant glazed systems are used. This fourth edition has expanded our original document to keep pace with changes in legislation and the constant product development undertaken by our diverse groups' membership. We have also added some new sections to reflect improved products and new releases.

We have a broad cross-section of individuals and companies that passionately engage with fire and life safety products. The GGF is best placed to represent the entire range of fire-resistant glazed components available. We have industry experts from fire test laboratories, glass manufacturers, seal manufacturers, frame system manufacturers, specialist glass distributors and glazing contractors.

As clients and designers require increasing levels of performance and protection, we have many bespoke solutions to ensure all aspects of safety and functionality are met. The FRGG continues to have the widest choice of materials and designs available that provide the best aesthetics with assured safety performance.

Our membership endorses the recommendations of the guide and will continue to work and stand by its principles to ensure that high standards are set and maintained in the supply and installation of these life safety products.

Stephen Bond
Pilkington UK & Ireland
Chairman FRGG

(The latest information can be found on the GGF's web site www.ggf.org.uk.)

Introduction

The Glass and Glazing Federation (GGF)'s Fire-Resistant Glazing Group (FRGG) is committed to the development and advancement of best practice in the manufacture, testing, specification, application and installation of fire-resistant glazed systems.

Our goal is to work with the wider fire safety community to achieve the optimum fire protection in our buildings. Our target is to develop best practice for fire-resistant glazed systems.

We will seek to meet our objectives by bringing together and making available the latest expert advice of those who work with fire-resistant glazed systems. We will also lead the industry in the development and application of the most appropriate best practice relevant to such systems.

The GGF, as the representative association of the glazing industry, only recognises those within the industry who endorse and subscribe to the policies, aims and objectives of the FRGG by membership of the group.

A necessary condition for FRGG membership is that members follow the principles defined in this document and that they promote, develop and champion the application of best practice in the use of fire-resistant glazing systems with a recognition of their responsibilities in ensuring fitness for purpose in the event of fire.

Glass and Glazing Federation
40 Rushworth Street
London
SE1 0RB

Telephone: 0207 939 9101

info@ggf.org.uk
www.ggf.org.uk

Note: the following terms are used in this guide

Responsible Person

- a) in relation to a workplace, the employer, if the workplace is to any extent under his control
- b) in relation to any premises not falling within paragraph (a)
 - i) the person who has control of the premises (as

occupier or otherwise) in connection with the continuation a trade, business or other undertaking (for profit or otherwise); or

- ii) the owner, where the person who controls the premises does not have control in connection with the continuation of a trade, business or other undertaking.

Where two or more Responsible Persons share this responsibility then they must co-operate, share information and work together to ensure that appropriate fire safety measures are implemented in the premises (e.g. tenant and landlord, multiple tenancy occupancy, adjacent premises).

Competent Person

This is a person appointed by the Responsible Person to undertake fire safety risk assessments, fire safety management of the premises or work associated with the installation and operation of fire safety systems within the premises under the requirements of the Regulatory Reform (Fire Safety) Order 2005.

The Competent Person may be an employee of the Responsible Person or a contractor with delegated responsibility for the safety of building occupants against fire. If the Competent Person is an employee, the Responsible Person must ensure that appropriate and sufficient training is provided so that the fire safety obligations can be competently discharged. If the Competent Person is a contractor, it is essential that the contractor must be able to demonstrate appropriate levels of competence, for example; by third-party accreditation.

Expert Judgment

Expert judgment is a permissible method of demonstrating compliance with the functional requirements of UK regulations, including the assessment of fire-resistance performance of systems, assemblies and constructions. This can involve, for example, complex engineering evaluations of structures that are not amenable to the application of prescriptive solutions, or relatively less complex evaluations of the expected fire performance of variations on a particular fire-resistant system that has appropriate test evidence.

Introduction

It is implicit that the expert is a practicing professional in the relevant field of fire safety and can demonstrate the appropriate knowledge, qualifications and experience.

It is also implicit that the judgment is related to one or more of the following: known fire behaviour, known material behaviour, test information, appropriate case studies, fire science principles or appropriate engineering-based equations and processes.

Responsibilities

The occurrence and development of fire are essentially unpredictable and uncertain, and its effects can be catastrophic for both life and property. There is therefore a shared duty of care on all those involved in the specification, testing, supply and installation of fire-resistant glazed systems. It is essential to ensure that the final installed system is fit to protect the building and its occupants against the effects of fire. Critical factors in achieving the intended performance in the event of fire are the quality and the reliability of product performance and satisfactory workmanship on installation.

A quick reference guide to the key factors to be considered in specifying fire-resistant glazing and appointing a glazing contractor

Define the Performance Specification

Confirm:

- Guidance in Approved Documents B or BS9999
- Alternatives to meet Building Regulations
- Application
 1. Internal or External
 2. Façade, screen or door
 3. Vertical, horizontal or inclined
 4. Frame material (timber, metal or other)

References:

- Section 1 – Basic Principles

- Bead designs
- Performance class
 5. Integrity Only
 6. Integrity with insulation
- Required Classification time
- Other performance requirements

Identify an Approved Fire-Resistant Glazing System

Check:

- Test evidence of performance
 7. Test report
 8. Assessment report
 9. Certificate from third party scheme

Reference:

- Section 2- Evidence of Fire Performance

Confirm:

- Details of glazing system to meet the required specification
 10. Classification report
 11. Declaration of Conformity
 12. Certificate of Conformity

Confirm Material and Glazing System Specification

Confirm:

- Glass type and name
- Seal type and name
- Frame materials and frame design
- Bead material and design

Establish:

- Points of detail governing fire performance

Reference:

- Section 3 – Fire-resistant glass
- Section 4 – Fire-resistant glazing seals
- Section 5 – Timber screens and doors

- Bead fixings
- Details of assembly
- Details of any finishes and decoration
- Check all relevant drawings
- Section 6 - Metal systems for screens and doors
- Section 7 – Frameless (butt-jointed) systems

Ensure Installation is Correct

Check with installer:

- Third party certification (e.g. FIRAS)
- Glass handling and storage
- Core competencies (NVQ or equivalent trained staff)
- Key skills and knowledge

Reference:

- Section 8 - Installation

- Labelling of the glass
- Refurbishment of the proposals
- Surrounding construction
- Records and documentation

Obtain Answers to Your Key Questions

- Contact a member of **GGF Fire-Resistant Glazing Group**

Reference:

- Appendix A

Introduction

Reference to the principle regulations, standards (BS or BS EN) and Codes of Practice

Approved Documents – England

These are documents created by The Department of Communities and Local Government (MHCLG), formerly the Office of the Deputy Prime Minister (ODPM) in England and Wales, to provide practical guidance on the requirements of the Building Regulations. If a designer fails to follow the recommended guidance given in the Approved Documents, then it is for them to prove to their client or the authorities if prosecuted, that an equally effective method or practice has been followed as an alternative. The Approved Documents (AD) particularly relevant to fire-resistant glazing systems and their application are as follows:

- Approved Document B – Fire Safety 2006 edition incorporating 2010 and 2013 amendments, volume 1 for dwelling houses, and volume 2 for buildings other than dwelling houses.
- Approved Document E – Resistance to passage of sound 2003, incorporating 2004, 2010, 2013 and 2015 amendments
- Approved Document K – Protection from falling, collision and impact 2013
- Approved Documents L1A, L1B, L2A, L2B – Conservation of fuel and power 2013 edition, incorporating 2010, 2011, 2013, 2016 and 20108 amendments.
- Approved Document M – Access to and use of buildings 2015, incorporating 2016 amendments, volume 1 for dwellings, and volume 2 for buildings other than dwellings.
- Approved Document Q – Unauthorised access 2015

Technical Handbook – Scotland

The building regulations are enforced through the building standards system that is established by the Building (Scotland) Act 2003. The Act sets out the

enabling powers that allow Scottish Ministers to make, not only the building regulations, but also procedural regulations, fee regulations and the other supporting legislation needed to operate the system. The system is designed to ensure that new buildings and works achieve the objectives of the Act in terms of health, safety, welfare, convenience, conservation of fuel and power, and sustainable development.

Guidance to achieve the required standards have been updated and may be found in:

Building (Miscellaneous Amendments) (Scotland) Regulations 2017 (1 July 2017)

Scotland has two sets of documents, Domestic and Non-Domestic Technical Handbooks.

The sections contained in the Technical Handbooks particularly relevant to fire-resistant glazing systems and their applications are as follows:

- Section 2 – Fire
- Section 3 – Environment
- Section 4 – Safety
- Section 5 – Noise
- Section 6 – Energy

Technical Booklets – Northern Ireland

Technical Booklets are published by the Department of Finance and Personnel in support of some of the technical parts of the regulations. They provide construction methods that, if followed, will be deemed-to-satisfy the requirements of the Building Regulations.

These booklets are specifically written for the use of individuals who have a sound knowledge of modern building techniques, terminology and practices.

There is no obligation to follow the methods or comply with the standards set out in the Technical Booklets (or any other named deemed-to-satisfy document). You may adopt any form of construction you wish; however you will be required to demonstrate to the satisfaction of district councils that the requirements of the building regulations have been met.

The Technical Booklets particularly relevant to

Introduction

fire-resistant glazing systems and their application are as follows:

- Technical Booklet E: 2012 – Fire Safety
- Technical Booklets F1: 2012 and F2: 2012 – Conservation of fuel and power in dwellings and buildings other than dwellings
- Technical Booklet G: 2012 – Resistance to the passage of sound
- Technical Booklet H: 2012 – Stairs, ramps guarding and protection from impact
- Technical Booklet V: 2012 – Glazing

Approved Documents – Wales

From 31 December 2011, the Welsh Government took on the responsibility for making and amending building regulations in Wales.

Each document contains:

- guidance on the performance expected of materials and building work to comply with the Building Regulations
- examples and solutions on how to achieve compliance for some building situations

There is no obligation to adopt a particular solution contained within the Approved Documents. Re-designed Approved Documents for Wales replace those issued by HM Government. The re-designed Approved Documents for Wales took effect from 3 April 2017. The documents currently relevant to fire-resistant glazing systems are as follows:

- Part B (Fire safety)
- Part E (Resistance to sound)
- Part K (Protection from falling)
- Part L (Conservation of fuel and power)
- Part M (Access to and use of buildings)
- Part N (Glazing safety)
- Regulation 7 (Workmanship and materials)

Relevant Codes of Practice and Standards

BS 5234-2 – Partitions (including matching linings) – Specification for performance requirements for strength and robustness including methods of test

BS 6180 – Barriers in and about buildings – Code of practice

BS 6262-1 – Glazing for buildings. General methodology for the selection of glazing

BS 6262-2 – Glazing for buildings. Code of practice for energy, light and sound

BS 6262-3 – Glazing for buildings. Code of practice for fire, security and wind loading

BS 6262-4 – Glazing for buildings. Code of practice for safety related to human impact

BS 6262-5 – Glazing for buildings. Code of practice for frame design considerations

BS 6262-6 – Glazing for buildings. Code of practice for special applications

BS 6262-7 – Glazing for buildings. Code of practice for provision of information

BS 8000-7 – Workmanship on building sites – Code of Practice for glazing

BS 9999 – Code of practice for fire safety in design, management and use of buildings

BS EN 12600 – Glass in building. Pendulum test, impact test method and classification for flat glass

BS EN 12758 – Glass in buildings. Glazing and airborne sound insulation. Product descriptions and determination of properties

BS EN 1990 – Eurocode: Basis of structural design – consists of 9 separate Eurocodes dealing with all aspects of structural design

Introduction

Key Points of Best Practice

Applications

- Glazed internal and external fire doors
- Interior partitions and compartments
- Roofs, floors and ceilings
- Façade glazing
- Escape and access corridor walls
- Stairways, lobbies and enclosures to protect shafts

Function

Fire-resistant glazing may be used as a barrier for fire separation or compartmentation as part of an integrated fire safety strategy for the building.

Both integrity-only and integrity with insulation performance ratings are available.

Products span the range of standard test times of 15, 30, 60, 90, 120 and even 180 or 240 minutes according to either BS 476: Part 21: 1987, BS 476: Part 22: 1987, BS EN 1364-1, BS EN 1364-2, BS EN 1364-3, BS EN 1364-4, BS EN BS EN 1634-1 or BS EN 1365-2 as well as special types to resist the higher intensity petrochemical (commonly known as the hydrocarbon curve) fire temperature/time test curve (if required).

The Fundamental Golden Rule

Fire-resistant glass must only be used as part of a fire-resistant glazing system – ***which includes the glass, the glazing seals, glazing beads, fixings and frame.***

All the essential components of such a system must be compatible under fire conditions and its performance must be referenced to appropriate and relevant test evidence.

Main factors that can affect performance

- Glass Type
- Maximum glass pane size (by height and width, not just area)
- Glass pane aspect ratio (i.e. height to width)
- Overall screen size and fenestration layout within

the screen

- Glazed system components (i.e. frame material, glazing seals and fixings)
- Framing system design for screens and façades
- Type of door, materials and construction
- Fabrication of the glazing aperture in doors (i.e. strictly according to the door manufacturer's instructions)
- Type and profile of glazing beads
- Type and mode of fixing for the beads
- For timber beads, the retaining screws, pins or nails must be angled to ensure that the glass is still held in place should the beads burn away
- The amount of edge cover and edge clearance when glazed, especially for modified Soda Lime Silicate toughened fire-resistant glass types
- Quality of workmanship

Note:

The final installation should reproduce the glazing assembly as approved. For example, if a single pane is tested, an assembly containing shared transoms and mullions should not be installed.

What to look for on site

- Official evidence from a competent authority demonstrating the fire-resistant performance of the glazing system used
- Evidence of installer competence (e.g. UKAS-accredited certification body)
- Permanent stamp on the glass that indicates as a minimum, the name of the glass product and the manufacturer/supplier and ideally the fire performance rating
- The stamp must be visible and readable after glazing
- Marking of the impact performance class (i.e. class 1, 2 or 3 according to BS 6262 part 4 and EN 12600) where applicable

Introduction

- Appropriate and proper storage of glass types and availability of appropriate handling equipment
- Full understanding and appreciation of health and safety aspects by those handling and installing fire-resistant glazing systems

Maintenance

- Visual inspection of glazing is required during routine fire risk assessments

Refurbishment

- Confirm with the 'Responsible Person' that the fire risks and fire hazards have not changed since the installation of the most-recent refurbishment
- Any necessary refurbishments must be carried out according to the approved original specification for the glazing system and should be completed on a like-for-like basis
- All components must be replaced with a new, complete and approved fire-resistant glazing system if the original glazing system specification cannot be established or was originally specified incorrectly

Horizontal or Inclined Overhead Glazing

Fire-resistant glazed systems are normally used in vertical locations, although horizontal and inclined glazing are possible using specialist systems. Contact manufacturers for details. Vertical test evidence cannot be used as evidence of compliance for any horizontally installed glazing

Always

- Install the fire-resistant glazing system according to configuration, design and materials as tested or assessed
- Ensure that the manufacturer's installation instructions are followed

Never

- Approve and use a fire-resistant glazing system that does not have relevant and applicable evidence of performance

- Substitute one glass for another, even if they have nominally similar specifications without appropriate test evidence
- Assume that standard impact safety toughened or safety/security laminated glass is fire rated
- Use standard, non-rated glazing seals and bedding materials
- Allow the mixing and matching of components between different approved fire-resistant glazing systems
- Allow on-site modifications that are not approved
- Install insulation performance glass in an integrity-only rated frame system where the requirement is for an insulation performance assembly
- Apply surface treatments or modifications to the glass after installation unless approved and endorsed by the glass manufacturer

SECTION 1:

Principles

Section Contents:

1. **Design Flexibility**
2. **Planning**
 - 1.1 **New Build**
 - 1.2 **Building Refurbishment**
 - 1.3 **Upgrade or Replacement**
3. **Fire-resistant glazed systems**
4. **Responsibilities**
5. **Application**
6. **Applicable standards for fire-resistance**
7. **Regulations covering fire safety**
8. **Classification of fire-resistance for UK Building Regulations**
9. **Building Regulations**
10. **Fire safety legislation**
11. **Building Regulation 38 (formerly 16B)**
12. **Fire-resistance classification to European standards**
13. **Property protection**

1. Design flexibility

The use of fire-resistant glazed systems encourages freedom and flexibility of design because of the unique performance range of glass, whilst providing the means to provide fire safety and other functional performance benefits at the same time. It is sometimes far too easy to assume that fire safety regulations impose a straitjacket on design. This is by no means the case when fire-resistant glass is used.

There are a large number of approved fire-resistant glazed systems available based on a varied range of fire-resistant glasses. Choice is far from restricted. Design innovation and creativity can be advanced rather than inhibited; by choosing one of the many different fire-resistant glazed systems.

Some types of fire-resistant glass have a wider range

of approved glazed system solutions than others, and the performance capabilities can also vary tremendously from one type of glass to another. An assumption must never be made that what can be achieved with one fire-resistant glazed system can be automatically achieved with another. Direct dialogue with glass manufacturers, or their agents, to identify the range of approved glazed systems that are possible is therefore always advisable and recommended.

2. Planning

Consideration must be given to the required fire-resistant glazed elements at an early stage in project planning and specification. This should include all aspects of specification and supply, in addition to those factors directly related to achieving the required design performance. Important factors to take into account from the outset include procurement, ordering, delivery, handling and site storage. All preparations should be made in good time; last minute changes or adjustments should be avoided; otherwise the building performance may fall short of the requirements.

Suitable delivery and lead-times should be built into the project plan and agreed with the supplier in good time before the expected arrival time on site in recognition that fire-resistant glazing systems are special high-performance products based on several matched components.

Best Practice Rule No 1

Only use fire-resistant glass as part of a fire-resistant glazed system and ensure that all components are compatible

2.1 New Build

Specification based on the guidance contained in Approved Document B (ADB), BS 9999 or an evaluation by a Fire Safety Engineer. Insurers may also have their own requirements for enhanced property protection.

The building architect/designer will specify the fire

SECTION 1:

Principles

protection measures based on the statutory requirements of the Building Regulations. Compliance with these regulations may be achieved through the use of details contained in Approved Document B, BS 9999 or through assessments conducted by Fire Safety Engineers. To ensure satisfactory performance, use the specification and installation guidance contained in this document.

2.2 Building Refurbishment

Specification based on the guidance contained in Approved Document B (ADB), BS 9999 or an evaluation by a Fire Safety Engineer. Insurers may also have their own requirements to ensure enhanced property protection.

If a building is undergoing a full refurbishment and/or a change-of-use, the same Building Regulation requirements relating to New Build will apply. The architect/designer will specify the fire protection measures based on the statutory requirements of the Building Regulation. Compliance with these regulations may be achieved through the use of details contained in Approved Document B, BS 9999 or through an assessment carried out by a Fire Safety Engineer.

Alternatively, the refurbishment may be localised to only a few items that will either be upgrades - where old components are replaced by newly-specified products - or replacements; where new or equivalent products are substituted for existing. In both cases it is necessary to establish the degree of fire protection required from a record of the original specification or more likely from a recent risk assessment carried out by a competent person. The guidance given in the relevant sections of this Best Practice Guide can then be used to ensure the correct products are specified and installed.

2.3 Upgrade or replacement

Following a risk assessment by a competent person, a visit by Fire Brigade or a requirement from the building insurers, the current level of protection has been identified as being insufficient and will therefore require upgrading.

Following a Risk Assessment carried out by a competent person, a visit by the Fire

Brigade or a requirement from the buildings insurers, it may be necessary to make glazed products fire resistant or increase the level of fire resistance. This may be due to incorrect product specification or installation or changes in the use of the space since the specification was determined.

Initially, the new required specification must be established in terms of the type of protection required, integrity-only or integrity with insulation and the length of time of protection required.

Evaluate the current installation to determine what level, if any, of fire resistance is currently provided, e.g. if timber doors are currently fitted, a 54mm-thick fire door is likely to be a 60-minute fire door whereas a 44mm thick door is likely to be a 30-minute fire door. Always check for labels or other indicators such as plugs, which will enable the performance rating to be confirmed.

Timber screens are more difficult to assess as these are purpose built based on an original fire test or assessment. Therefore, unless details of the original build are available, the assessment needed will be based on the knowledge and experience of the person carrying out the survey/assessment. If insulation is required and the glass cannot be identified as insulating glass, it must be replaced with a suitable product that meets the fire resistance specification required (see table 2 in section 3 of this Guide for a list of suitable glasses and manufacturers).

In some cases, the edge cover is important; contact the glass manufacturer/supplier to confirm.

There should be appropriate fire rated glazing seals between the glass and beads. These will often be intumescent glazing seals but may be other materials, such as rubber. However, in all cases, they must have been the subject of a fire test in a glazed application to either BS 476-22 or EN 1364-1. If the glazing specification is for 60 minute resistance, the glazing rebate may also need to be lined with an intumescent liner strip as shown in Fig 6 section 5.

SECTION 1:

Principles

For metal screens and doors, the original manufacturer should be identified, and the installation details checked against their specification, which has been determined by fire test or assessment.

3. Fire-resistant glazing systems

Fire-resistant glazing provides excellent protection for lives and property in the event of fire. The fire environment is a hostile one for all materials and its occurrence and propagation is essentially unpredictable with uncertain outcome. It is therefore critical that the specification, selection, and installation of fire-resistant glazing are all carried out with close attention to detail.

Fire-resistant glass can only achieve its designed performance when it is part of a complete fire-resistant glazed system. This means that all component parts, such as the glazing seal, beads, fixings and frame material, must all be compatible and work together to achieve the required performance.

The fire-resistant glazed system must also be installed as tested or assessed by an appropriately qualified authority. Different types of fire-resistant glass may require different glazing details, e.g. the glass edge cover, which must not be changed or assumed to apply to other glass types. Installation must be carried out by competent individuals who can demonstrate the necessary knowledge and skills required (see Section 9).

ALWAYS:

- Check with the supplier that there is relevant and appropriate evidence of fire-resistance performance
- Ensure correct installation of the glazed system, which is fundamental to the achievement of its stated fire-resistance performance

NEVER:

- Assume that the substitution of one component for another will result in the same level of fire-resistance, even if the components in question are nominally similar

- Mix and match components from different approved systems
- Be tempted to take short cuts by reducing the performance specification

4. Responsibilities

There is a shared duty of care incumbent on all those involved in the specification, manufacture, testing, supply and installation of fire-resistant glazed systems, to ensure that the final installed system is fit to protect the building and its occupants against the effects of fire.

All those involved in the process need to be aware of their individual responsibilities and obligations, taking particular responsibility for the consequences of what they do or might not do, concerning the fire-resistance performance of the glazed system in the event of a fire.

Glossary of terms

The cross-sections in Figures 1 and 2 show fire-resistant glazed systems labelled with most commonly used terms and components. These terms are used throughout this Best Practice Guide.

SECTION 1: Principles

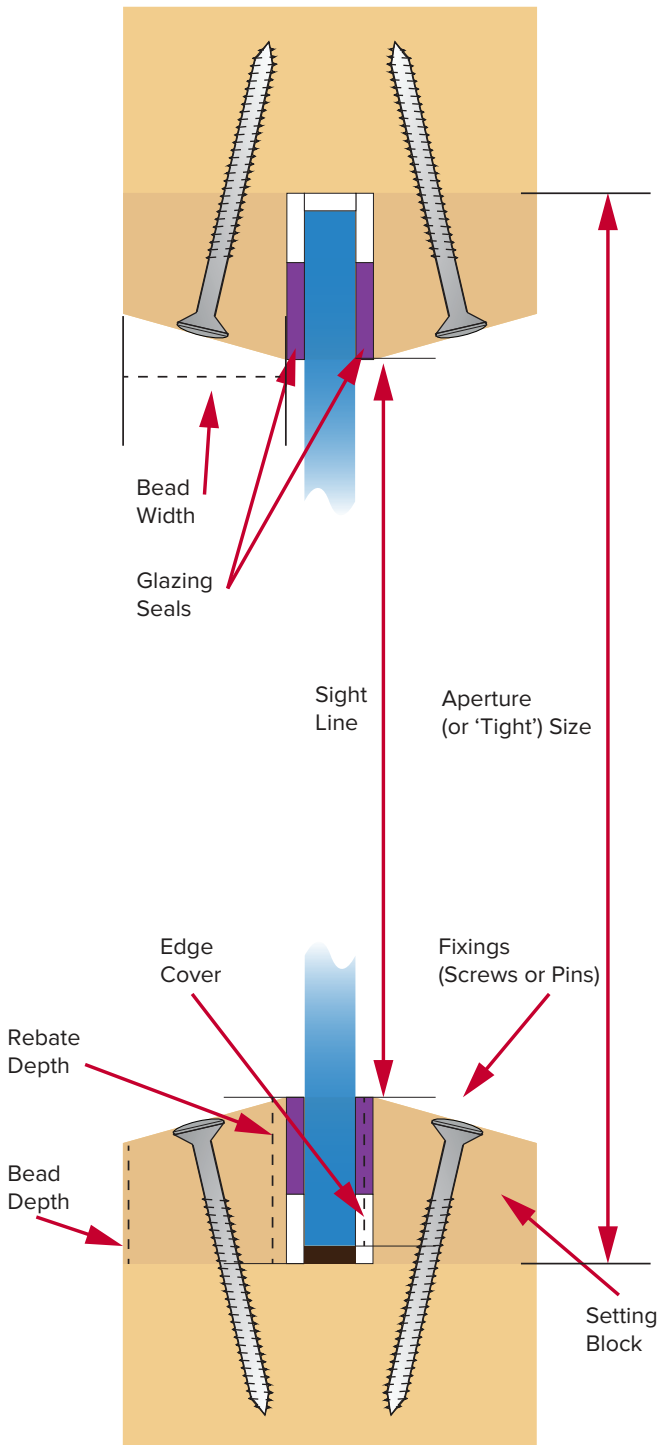


Figure 1 – Example components of a typical glazed timber door leaf

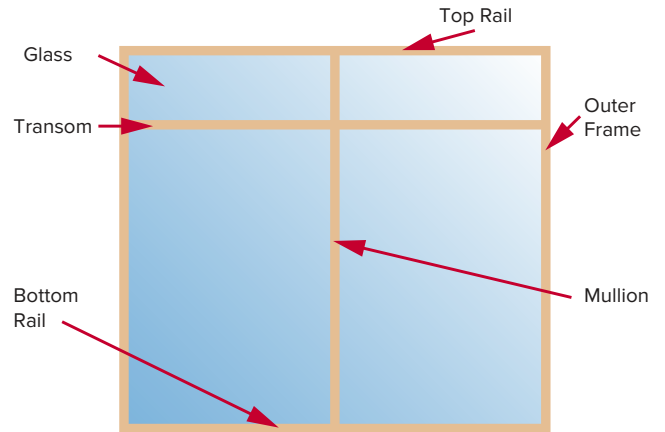


Figure 2a – Example of typical glazed timber screen

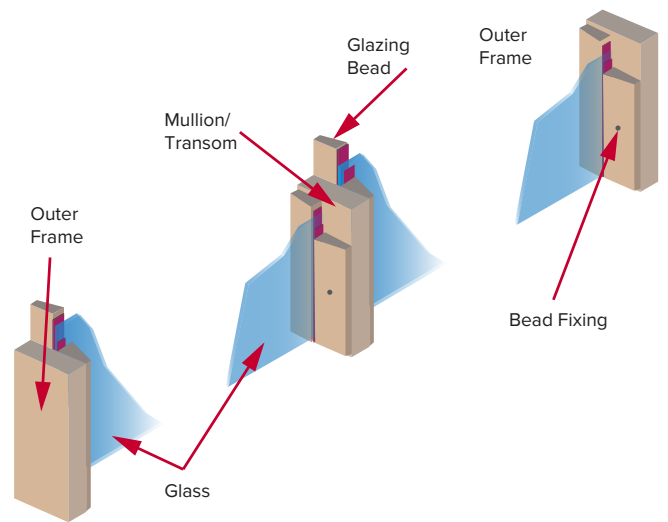


Figure 2b – Vertical section through glazed timber screen

SECTION 1:

Principles

5. Applications

The glass must be tested and classified in a proposed end-use application, e.g. screen, door, roof, floor or façade in a glazed system appropriate for that application.

Any test or assessment report for one application must not be used to cover other applications.

Approval in a vertical orientation must not be taken to imply approval in a horizontal or inclined orientation.

Key factors that influences fire-resistant of glazing systems

- Maximum pane area
- Glass pane aspect ratio
- Fenestration layout and overall size of screen
- Type of glazing seal
- Frame material
- Frame design and construction
- Type and shape of beads
- Extent of glass edge cover (for example, for modified toughened soda-lime glass)
- Type location and application of fixings for both frame and beads
- Type of door materials and construction
- Orientation – Vertical, Horizontal or Inclined

6. Applicable standards for fire-resistance

Fire-resistance is a characteristic of an element of construction or of a complete assembly. A classification of fire-resistance for the glass in isolation is therefore not possible.

Fire-resistance is always stated with reference to defined criteria which can only be determined on the basis of a furnace test carried out in accordance with a given test standard. Relevant standards for the UK are as follows:

- BS 476-21, Fire tests on building elements and structures – Methods for the determination of fire-resistance of load bearing elements of construction
- BS 476-22, Fire tests on building elements and

structures – Methods for the determination of fire-resistance of non-load bearing elements of construction.

- BS EN 1363-1, Fire-resistance tests – General requirements
- BS EN 1363-2, Fire-resistance tests – Alternative and additional procedures
- BS EN 1364-1, Fire-resistance tests for non-load bearing elements – Walls
- BS EN 1364-2, Fire resistance tests for non-load bearing elements – Ceilings
- BS EN 1364-3, Fire resistance tests for non-loadbearing elements. Curtain walling. Full configuration (complete assembly)
- BS EN 1364-4, Fire resistance tests for non-loadbearing elements. Curtain walling. Part configuration
- BS EN 1634-1, Fire-resistance tests for door and shutter assemblies – Fire doors and shutters
- BS EN 13501-2, Fire classification of construction products and building elements – Classification using data from fire-resistant test, excluding ventilation services
- BS EN 1365-2, Fire-resistance tests for load bearing elements – Floors and roofs

7. Regulations covering fire safety

The UK Building Regulations are covered by three separate documents based on common principles with differences only in points of individual detail:

The principles can be illustrated by reference to Approved Document B (ADB).

8. Classification of fire-resistance for UK Building Regulations

Integrity - is the ability of a material to withstand fire exposure on one side without the transmission of fire as a result of the passage of flames or hot gases. An integrity barrier acts in effect to physically stop fire movement. Alternatively, integrity may be referred to as non-insulating.

SECTION 1:

Principles

Insulation - is the ability of a material to withstand fire exposure on one side without the transmission of fire to the unexposed side by limiting heat transfer due to conduction, convection or radiation (in addition to integrity).

Note: Fire performance insulation must not be confused with the energy insulation requirement of insulating glass units for external glazing to reduce energy losses from buildings (Conservation of fuel and power). Also, fire resistance is not solely a function of time. Specifications must always specify time, integrity and insulation (where appropriate).

Achievement of the insulation criterion is measured by thermocouples on the cold face of the glass and frame. To meet the requirements of insulation, the average temperature increase across the specimen at defined locations must remain below 1400C, with no point rising by more than 1800C above ambient.

Note: Failure of insulation does not necessarily mean that integrity failure has occurred.

For the purposes of UK Building Regulations, performance is defined in terms of...

- Either integrity-only, or
- Integrity and Insulation

...at a standard test time period, e.g. 15, 20, 30, 60, 90, or 120 minutes according to the building type, the application (e.g. walls, doors, floors) and location (e.g. internal or external, corridor, lobby or stairway).

The final classification may be expressed in concisely as follows, for example:

- 30 minutes integrity and 30 minutes insulation, "30/30"
- 30 minutes integrity-only; no insulation, "30/0"

9. Building Regulations

Building Regulations are intended to ensure that a reasonable standard of life safety is provided in the event of fire. The guidance in AD B provides methods to achieve compliance and apply to common building situations. There is no obligation to adopt any particular solution contained in the approved document, but in that case, compliance with the relevant functional requirement should be met in some other way, with associated substantiation and

evidence. This would normally include either specific system and assembly testing or a wider-ranging engineering-based evaluation.

Property protection is not specifically included within the scope of regulatory guidance and therefore additional measures are often required beyond those required for life safety.

The main provisions of AD B are intended to ensure that structures remain safe in the event of fire, to:

- Allow occupants to reach a place of safety
- Prevent structural collapse for a sufficient time period to allow evacuation
- Limit further fire spread
- Provide satisfactory means of access for fire-fighters

Particular appendices and tables in AD B relevant to fire-resistant glazed systems are:

- Appendix A, Performance of materials, products and structures
- Table A1, Specific provisions for fire-resistance of elements of structure
- Table A2, Minimum periods of fire-resistance
- Table A4, Limitations on the use of un-insulated glazed elements on escape routes
- Appendix B, Fire doors
- Table B1, Provisions for fire doors

If specifiers choose not to follow the guidance in Approved Document B, then it is their responsibility to demonstrate that the functional requirements of Building Regulations are met in some other way, with the associated substantiation and evidence.

This would normally include either specific system and assembly testing or a wider-ranging engineering-based evaluation.

SECTION 1: Principles

Part B1	Means of Escape	Insulating and/or non-insulating glass types can be used in lobbies, corridors and stairways. Guidance typically is for a minimum of 30 minutes fire-resistance
Part B2	Internal Fire Spread (linings)	Glass is a material of limited combustibility which meets the requirements of the highest performance class for surface spread of flame (i.e. Class 'O'), provided that there are no coatings or decoration that change its combustibility.
Part B3	Internal Fire Spread (structure)	The requirement for separation between compartments must be for integrity and insulation up to a maximum of 120 minutes, depending on the situation. Various glass types can provide fire resistance up to these levels of performance. The relevant fire protection strategy is compartmentation (i.e. a fire control and separation strategy to prevent fire spread by restricting fire to its area of origin).
Part B4	External Fire Spread	This refers to the control of fire spread from building to building by using fire-resistant products and classified surface spread of flame products when close to facing buildings and relevant boundaries, according to defined distance criteria. Additional measures to prevent fire movement in the same building (e.g. use of fire-resistant glass facades) may also be relevant.
Part B5	Access for Fire Brigades	Access for fire-fighters into buildings is provided by fire safety access routes brigades which require integrity and insulation, as well as a Class 'O' surface spread of flame. Some fire-resistant glass types can meet these requirements up to a maximum of 120 minutes, if necessary

Table 1: Sections in Approved Document B relevant to fire-resistant glazed systems.

SECTION 1:

Principles

The range of applications for fire-resistant glazed systems is summarised right and Figure 3 shows an example of typical functional performance guidance.

AD B, as issued in April 2006, is in two volumes: volume 1, dwelling houses; volume

2, buildings other than dwellings. Particular points of guidance relevant to best practice are as follows:

- The need to carry out any building work in compliance with Regulation 7, with proper materials and in a workmanlike manner
- Recommendations on the role of independent schemes of certification for products and accreditation of installers, as a way of providing evidence for the confidence of Building Control in satisfying themselves of compliance with regulations
- The provision of appropriate information and documentation for effective
- fire safety management of the building (Regulation 38)
- The importance of inclusive design (e.g. taking into account Part M of the regulations, Access to and use of buildings)
- Advise that fire-resistant glass should be marked with manufacturer and product name, ADB - Vol 2 - Table A4 and section 9 of this guide
- A reminder that additional measures are often required and that insurers may request higher standards
- Compartment walls should be able to accommodate the predicted deflection of the floor above (section 8 of this guide)

Note: Approved Document B can be accessed on the Communities and Local Government web site, www.planningportal.gov.uk

Summary of applications for fire-resistant glazing systems

Reference Approved Document B (or equivalent)

Means of escape

- Corridors
- Doors
- Stairwells
- Lift shafts
- Protected lobbies leading to a protected stairway
- Protected refuges for phased evacuation

Fire containment compartments

- Fire walls and protected openings in compartment walls

Fire separation

- Protected areas within compartments
- Enclosures for spaces of special fire hazard
- Floors and horizontal glazing panels
- Separation of new storeys in existing dwellings

External building envelope

- Walls
- Doors
- Skylights
- Roofs
- Façades

Fire-fighter access

- Protected shafts and corridors

Load-bearing fire-resistant glass floors

- Lobby areas leading to protected shafts

SECTION 1: Principles

Example - A single storey shop with office and storage areas

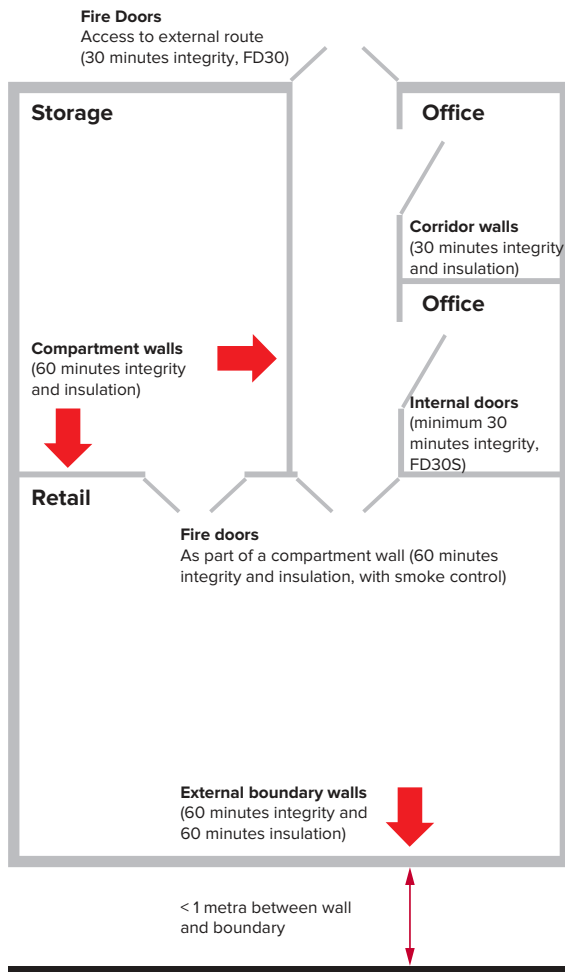


Figure 3: Building plan showing possible fire-resistance requirements

10. Fire safety legislation: The Regulatory Reform (Fire Safety) Order

Ongoing control of the occupied building for effective fire safety, after design and construction, is provided by the Regulatory Reform (Fire Safety) Order 2005, which came into force on 1st October 2006. This order applies to England and Wales and covers all non-domestic premises, including the communal areas of premises that contain one or more dwellings. (Separate laws apply in Scotland and N Ireland.)

The FSO is now the dominant piece of legislation governing fire safety, replacing previous legislation such as the Fire Precautions Act 1971, under which fire certificates were previously issued for defined building categories. It brings fire safety into line with established health and safety principles and thus introduces a methodology based on risk assessments for fire safety that encompass fire precautions, management, protection and preventative measures, training and information.

Responsibility and accountability for compliance with the statutory requirements rests with the person who is directly responsible for the building (normally the owner or employer, as applicable, defined as the Responsible Person). Inspection and enforcement powers rest with the Fire and Rescue Service, including the facility to impose enforcement orders in cases of non-compliance.

Significantly, the provisions of the order cover contractors carrying out refurbishment or re-construction work within the building to ensure that the fire safety provisions are not impaired by such work. This could specifically cover, for example, replacement glass, the repair of installed fire-resistant glazed systems and new glazed doors or partitions.

See separate guidance section 9.

Note: Guidance documents can be accessed on the Communities and Local Government web site, www.communities.gov.uk/fire

11. Building Regulation 38 (formerly 16B) - Fire Safety Information

Approved Document B (2006) has been prepared on the assumption that the building concerned will be properly managed for life safety throughout its working life. This applies in particular to the provision of information on the design and construction of buildings which are covered by the Regulatory Reform (Fire Safety) Order 2005, where the work potentially affects life safety. Regulation 38 (formerly Regulation 16B) provides this link and its stipulations are mandatory. It is clearly of fundamental importance for the Responsible Person to be made aware of both the details of all fire safety measures installed and

SECTION 1:

Principles

applicable underlying assumptions.

The objective of Regulation 38 is to ensure that relevant information produced at the construction stage is passed on to the Responsible Person so that the risk assessment process can be as fully informed as possible. The regulation is obligatory and applies to the information that should be provided on initial construction, extension or material change of use.

General guidance on the type of information to be provided is given in Appendix G of Approved Document B (2006 edition), volume 2.

For best practice in fire-resistant glazed systems, the GGF would expect the installer to provide the following information:

- An accurate description of the fire-resistant glazed system as installed, with a listing of all the key components by name and manufacturer (i.e. glass, glazing seal, frame, type of fixings and their specification, beads and fixings of the frame to the surrounding structure)
- For timber frames, the type of timber and its nominal density
- Location of the glazed system, ensuring correct recording on associated plans
- Marking of the fire-resistant glass to be clear and visible after glazing (reference
- AD B - Table A4 and section 9 in this guide)
- Statement of the classified fire-resistance performance of the glazed system
- Evidence of the classified performance, either with the relevant test report or reference to where the test report can be obtained if necessary
- Statement of performance for other key properties, e.g. for impact safety, acoustic insulation, use as a barrier (Appendix B)
- Relevant guidance on maintenance and upkeep of the system during its working life
- Special guidance on replacement or refurbishment, if applicable. (Note: The normal GGF

recommendation is to replace the glazed system as originally specified or replace in its entirety, see section 9)

12. Classification of fire resistance to harmonised European Norms (hEN's)

The European classification standard BS EN 13501-2 includes a provision for both integrity and insulation according to the same definitions applicable to UK regulations. Under the European scheme, the symbol **E** is assigned to integrity, **I** to insulation and **W** to radiation.

Provision is made within the classification scheme defined in this standard to use a range of standard test time periods, i.e. 15, 20, 30, 45, 60, 90, 120, or 180 minutes.

BS EN 13501-2 also introduces a supplementary criterion of radiation (designated by W) to cater for those limited number of countries whose national regulations require this performance category. Radiation is defined as the ability of a material to withstand fire exposure on one side and reduce the probability of transmission of fire by significant heat radiation to adjacent materials. Radiation must be determined by measurement in a standard fire test.

An element that meets the insulation criterion is automatically deemed to meet the radiant heat criterion without measurement.

Product classification to BS EN 13501-2 can then be described using shorthand as follows, for example:

- Integrity-only for 30 minutes, "E30"
- Integrity and radiation protection for 30 minutes, "EW30"
- Integrity and insulation for 30 minutes, "EI30".

An amendment was issued to Approved Document B in 2006 to provide visible recognition to the new European technical specifications, classification standards and supporting fire test methods, which have been developed in support of the Construction Products Regulation (CPR). Table A1 in the amendment stipulates the minimum provisions expressed in terms

SECTION 1:

Principles

of the classification scheme given in BS EN 13501-2 when tested to the relevant European standard. There are no changes to the minimum periods of fire-resistance given in Table A2.

Radiant heat and BS EN 13501-2

The radiation performance category (W) is defined in BS EN 13501-2 at a qualifying maximum total heat flux of 15 kW/m^2 . Values are determined based on measurements according to BS EN 1363-2 at a standard distance of 1 metre from the glazed element at the end of the standard fire test time period (e.g. 30 or 60 minutes as appropriate). This criterion can be achieved by only certain types of integrity glass (and automatically by using an insulation glass). It is not necessary to measure radiant heat (W) from insulation glazed systems because the total heat flux for such products is so low (typically less than 1 kW/m^2).

Guidance in UK Building Regulations (e.g. Approved Document B, or equivalent) does not include radiation.

For those countries where the fire regulations require a radiation performance category, then this is typically applied at boundary conditions

and along fire escape routes to allow for the safer passage of people in the event of fire, when compared with basic integrity function.

Where levels of radiant heat are concerned, there are major differences between insulation (EI) and integrity (EW) glass types. The EW category should not, under any circumstances, be seen as a lower level of insulation performance. The EW category is a diffuse one: the maximum limit allows the inclusion of glazed elements with measured radiant heat values from, for example, 3 kW/m^2 up to 15 kW/m^2 without differentiation; radiant heat depends critically on glass area, aspect ratio, orientation and distance from the glass surface. Furthermore; and all integrity glass types can be included within the classification by choosing an appropriate glass radiating area. The EW classification is therefore a feature of the particular glazed element that has been tested and not a fundamental glass characteristic.

13. Property protection

The primary emphasis of Approved Document B or equivalents in Scotland and Northern Ireland is the prevention of injury and death in the event of fire, although a by-product of these requirements can be that the structure of the building and its contents usually benefit from a degree of protection from fire as well.

Although performance-based fire safety engineering can be used to deliver the same level of life safety, it may dispense with building or content protection. This may also compromise the ability of a business to continue to trade. Therefore issues concerning property and asset protection and business continuity

are of particular interest to insurers who may impose their own design requirements in relation to fire protection. The overall requirements can be addressed through a Qualitative Design Review (QDR), which defines where the scope and objectives of the fire safety design are defined and where performance criteria are established and acceptance criteria set.

It is likely that insurance surveyors will make reference to the guidance contained in

“Design Guide for the Fire Protection of Buildings” published by the Fire Protection Association (FPA) on behalf of the Association of British Insurers or “Approved Document B: Fire Safety (Volume 2) - Buildings other than dwellinghouses Incorporating Insurers’ Requirements for Property Protection” when

SECTION 1:

Principles

assessing potential insurance liability of a building. This publication is produced by RIBA Publishing in association with RISC Authority and FPA. FRGG supports the 12 essential principles for fire protection which have direct relevance to the application of fire-resistant glazed systems. These are as follows:

Reaction in the event of fire

Principle 1

The building shall be constructed in such a manner that if a fire starts, the extent of fire and smoke damage will be minimised and confined as close to the source of the fire outbreak as is practical/feasible.

Principle 2

- With the exception of joinery products, the building shall be constructed from building materials/products that will not make a significant contribution to the early stages of a fire or contribute to the spread of fire.

Principle 3

- Suitable measures will be taken for the prevention of premature structural collapse and excessive deflection.

Principle 4

- Consideration should be given at the design stage regarding potential damage from firefighting water and to ensure as far as practical that the effect on the environment of the fire effluent will be minimised.

Workmanship

Principle 5

- As a minimum, all fire protection products shall be third-party certified to an appropriate product or performance-based standard (attestation level 1 for CE marking).

Principle 6

- All fire protection products/systems shall be installed by adequately trained specialist installers.

Response to fire

Principle 7

- The building shall be fitted with an appropriate automatic fire alarm system.

Principle 8

- The fire protection systems shall be regularly maintained so that they are able to perform their intended function throughout the life of the building.

Fire prevention

- Principle 9
- There shall be adequate provision to prevent an arson attack.
- Principle 10
- The building shall be so constructed that fire cannot spread into the premises from an adjoining building.

Fire safety management

Principle 11

- The building owner shall ensure an adequate standard of fire safety management throughout the life of the building.

Principle 12

- Any fuel-burning or electrical appliances and services shall be designed, constructed and installed in a manner that reduces their potential as an accidental source of ignition.

SECTION 2:

Evidence of Fire Performance

Section Contents:

1. Introduction
2. Test Reports
3. Assessment Reports
4. Third-party Certificates
5. CE Marking Process
6. EC Certificate of Conformity
7. Classification report
8. EC Declaration of Conformity
9. Field of application
10. CE Marking and harmonised European Product Standards and European Technical Approval Guidelines

1. Introduction

The guidance given in Approved Document B (England and Wales) or the equivalent for Scotland and Northern Ireland is that fire-resistance performance is determined by reference to tests either in British Standards, i.e. BS 476 series, or European Standards, i.e. BS EN 1364 parts 1-4 for walls, ceilings or curtain-walling, or BS EN 1634 part 1 for doors. With the emergence of the European market, European tests are becoming more prevalent and GGF members conduct fire resistance tests to EN standards for future applications. Test evidence generated to these Standards may be used to generate a number of different documents that demonstrate the product performance claims. These are:

- A test report
- An assessment report
- A certificate provided by a third-party product certification scheme (this is normally voluntary)
- An EC Certificate of Conformity (used only for CE Marking and therefore is a mandatory requirement in most European Countries)
- A classification report (in accordance with BS EN

13501-2)

- A manufacturer's declaration of conformity (used only for CE marking and therefore is a mandatory requirement in most European countries)
- A direct and/or Extended Application report (in accordance with BS EN
- 15254-4 for glazed partitions or BS EN 15269-2 or 3 for steel or timber doorsets respectively)

Best Practice Rule No. 2

Always make sure that there is relevant evidence to performance for the installed glazed system, based on test data.

Symmetry of test samples

If the glass frame is asymmetrical in cross-section then the glazed system should either be tested with both sides towards the fire or if it has been established that once orientation has a lower performance than the other, with that side towards the fire. Appropriate installation instructions should be provided accordingly.

2. Test Reports

Fire-resistant glazed system test reports should only be accepted if they are from an appropriately accredited test laboratory, e.g. a Notified European Test Laboratory or one accredited by UKAS. The test report is only applicable to the specific system as tested and the evidence provided therein should not be used beyond the specific application tested. Test reports are confidential to the sponsor of the relevant testing and must not be used in support of a particular construction without their permission.

The test report is only applicable to the specific system as tested.

Test reports are confidential to the sponsor of the relevant testing and must not be used in support of a particular construction without their permission.

SECTION 2:

Evidence of Fire Performance

3. Assessment Reports (in-lieu of fire resistance tests)

Fire resistant glazing systems have a range of possible variations suitable for particular applications. These variations may be cosmetic features with no significant effect on performance or more fundamental changes which are likely to influence fire performance, such as bead thickness or timber treatment. The range of possible variations makes it uneconomical to test all options and, in some cases, the glazed assembly may be too large to test in the available test furnaces.

In these cases, variations to the tested system may be approved on the basis of technical assessment to the appropriate standards, using the test evidence that is available.

The fundamental guiding principle governing assessments is that the assessed performance would be achieved if the glazing system were to be tested.

The following points should be kept in mind when referring to or relying on assessment reports:

- Assessment reports must only be carried out by appropriately qualified persons who can demonstrate the necessary knowledge and experience of fire-resistant glazing systems
- Only assessments carried out to the criteria defined by the Passive Fire Protection Federation should be used (PFPPF Guide to Undertaking Assessments in-lieu of Fire Tests)
- The use of test data from tests that are not observed by the responsible assessment authority is not best practice
- The test data must be relevant and applicable both to the glazed system under consideration and its proposed application
- Assessments may be either interpolation between test data or extrapolation from test data
- Test data relating to one type of glass must not be used to support the application of another
- If test evidence that contradicts the conclusions of

the assessment subsequently becomes available, then the assessment must be withdrawn

- An assessment gives no guarantee concerning the system's consistency of manufacture

4. Third-party certificates

These relate to national schemes developed by certification bodies to provide reassurance to the manufacturing process and product consistency of fire-resistant glazing systems. Third-Party Certification is a higher level of attestation than tests and/or assessments used in isolation. The requirements of certification should include fire performance and other relevant key parameters (especially impact safety and durability). The use of appropriate third-party product certification schemes is recommended, as these can help to ensure that products are made consistently, that their intended end use is supported by appropriate test evidence and that this end use is properly defined. Appropriate product certification schemes include:

- CERTIFIRE and QMARK, from Exova
- BWF CERTIFIRE for timber doors

The GGF endorses the above certification schemes

Third-party product certification schemes should:

- Be accredited by an accreditation body, e.g. UKAS or equivalent
- Include independent sampling and testing of fire performance of the glass
- Include independent testing and sampling of other key properties relevant to the application (e.g. impact safety and durability)
- Require surveillance of the factory production control system by scheme personnel (or their authorised representatives) to check product consistency
- Require auditing of independently selected glass product from either the production line or the market (as required)
- Refine scheme qualification criteria

SECTION 2:

Evidence of Fire Performance

- Define procedures in the event of demonstrated non-compliance including the possibility of product recall if necessary

5. CE Marketing

CE Marking process – at time of publication there is only a requirement to CE mark (and therefore provide a declaration of performance and label) for fire-resistant glass and external fire-resistant doors.

A revision to harmonised European standard EN14351 (forecast release date of late 2018) part 1 will include internal fire-resistant door sets; and after an overlap period of the old (BS 476 part 22 “Fire tests on building materials and structures. Method for determination of the fire resistance of non-loadbearing elements of construction”); CE marking will then also be mandatory for internal fire-resistant door sets.

In order to produce a declaration of performance and CE mark; the product must have third-party certification issued by notified product certification body.

6. EC Certificate of Conformity

This is a document signed by a Notified Certification Body (i.e. a body nominated and approved by Member State authority). It confirms compliance with the relevant European (EN) product standard, attests that the claims of the manufacturer are accurate and that the product has been manufactured using an appropriate factory production control system which meets the requirements defined in the relevant European product standard.

7. Classification Report

The European process requires a classification report to be issued following a successful test or series of tests. This is to convert the test results into a classification in accordance with EN 13501-2, which is applicable throughout the European Community. All the relevant tests used as a basis for the classification shall be referenced in the report. The classification report should contain a brief description of the tested element, test results and any Direct or Extended Applications (see below) that may determine the

scope of the final classification. The classification is based on E to signify integrity, W to signify radiant heat and I to signify insulation. The appropriate classification letter is followed by a number that designates the standard test time period achieved (e.g. E 30, integrity 30 minutes; EI 30, integrity and insulation 30 minutes).

8. EC Declaration of Conformity

A declaration of conformity is signed by the manufacturer or supplier. This declaration can only be made once a Certificate of Conformity - which references an appropriate classification report - is available.

By signing this declaration the manufacturer/supplier is taking responsibility that the product will achieve its declared characteristics in the particular end-use applications, as defined in the scope of the declaration. It refers specifically to CE Marking for the product in question.

9. Field of Application

This refers to the extent to which the results of test data can be used to provide increased scope of application for a specific fire-resistant glazed system. Using the test data as a basis, the field of application defines parameters such as the limits of glass size, frame requirements and supporting construction requirements.

There are two types of application:

- Direct application
 - BS EN 1364-1 and BS EN 1634-1 allow for certain extensions for the glazed system under consideration, according to specific clearly defined rules as defined in the test standards. These applications always apply to the test result and test report under consideration.
- Extended application
 - Further extension beyond the direct field of application is possible but only on the basis of rules defined in accordance with BS EN 15254 part 4 (for glazed partitions), part 5 (for

SECTION 2:

Evidence of Fire Performance

metal-framed glazed doors), part 6 (for curtain-wallings) or BS EN 15269-2 or 3 for steel or timber doorsets respectively. These rules are based on the collective judgement and experience of industry experts. Extended application applies to the data obtained from one or more test results, and is only allowed within the scope of the provisions given in governing European standards. They are equivalent to carrying out UK assessments, except that the extended applications are based upon published 'rules' and have validity across Europe.

10. CE Marking and harmonised European Product Standards and European Technical Approval Guidelines

EN standards apply across the European Economic Area (EEA) and are produced by the European standards body, CEN. There are four types of such standards covering testing, products, classification and Extended Application. The CE Mark demonstrates compliance with the European standards that have been developed under the Construction Products Regulation (CPR). The prime objective of CE Marking is to facilitate cross-border movement of goods within the European Community by removing technical barriers to trade. The CPR is a European directive adopted by all member Governments by their national legislation." Safety in case of fire" is one of the six essential requirements under the CPR. In order to be able to CE-mark a product under the CPR it is required that a harmonised Product Standard or a European Technical Approval Guideline is available. For most glass products, these are now applicable and therefore CE marking is mandatory in most European countries.

CE Marking Summary

Process:

- **Certification and supervision by a Notified Certification Body (NCB)**
- **Independent sampling of specimens for internal type testing, under the authority of a Notified Certification Body**
- **Independent verification of factory production control, by a Notified Certification Body**
- **Tests to European Standards carried out at a Notified Test Laboratory**

Associated documentation:

- **Test report(s) (from the Notified Test Laboratory)**
- **Extended Application report (if relevant)**
- **Classification report (if relevant)**
- **Classification report (from the Notified Test Laboratory)**
- **Certificate of Conformity (from the NCB)**
- **Manufacturer's declaration (provided by the manufacturer/ supplier)**

SECTION 2:

Evidence of Fire Performance

Alternative Routes to Demonstrate Fire-Resistance Performance

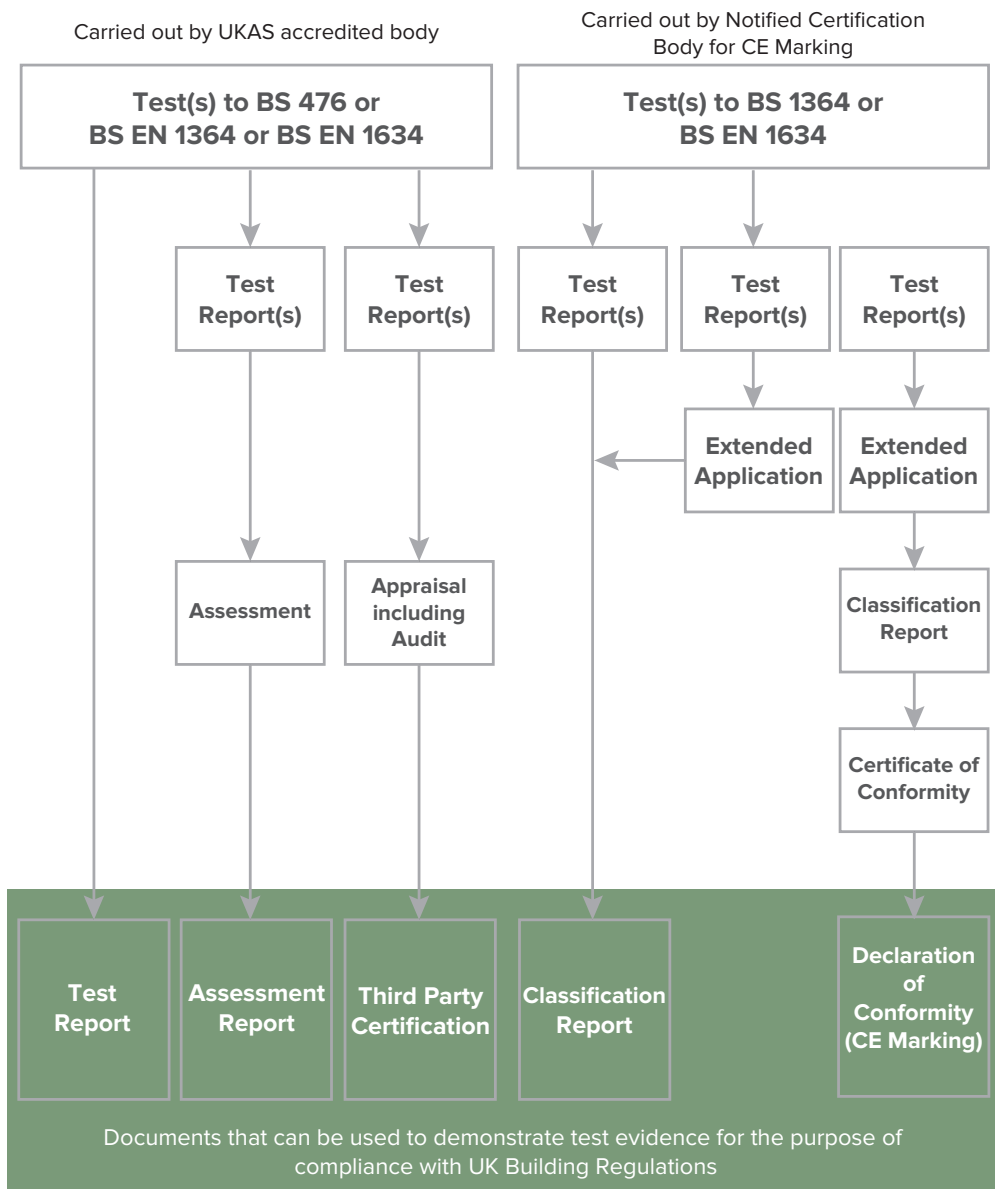


Table 3—Routes to demonstrate fire-resistance

Notes:

- CE Marking is not a quality mark (although the process of demonstrating conformity does include elements similar to those normally associated with product quality schemes)
- CE Marking may only be claimed by the manufacturer through a 'Manufacturer's Declaration' which refers to a test report and a classification report provided by a Notified Certification Body
- CE Marking for glass products may be shown either on the product, or on packaging, or on associated documentation
- False declarations carry financial and/or custodial penalties, under the surveillance of Trading Standards

SECTION 3:

Fire-Resistant Glass**Section Contents:**

1. **Glass Types**
2. **Performance in the event of fire**
3. **Fire-resistant insulating glass**
4. **Horizontal and sloped glazing systems**
5. **Decorative treatments on glass**
6. **Combining other performance requirements with fire-resisting glazing**

1. Glass Types:

Fire-resistant glass can be based on a number of different glass technologies.

These are summarised in tables 2 and 3.

Table 2: Glass types

Glass Type (relevant EN product standard in brackets)	Fire-Resistance	Trade Name	Manufacturer For FRGG suppliers, see Appendix A
Wired (EN 572-3 & EN 572-6)	Integrity	Pyrostem	Pyroguard
		Pyroshield 2 Texture Pyroshield 2 Safety Clear	Pilkington
Ceramic (EN 1748-2-2)	Integrity	Firelite Firelite-SL Firelite-SF	Ceramic Glass Ltd
		Keralite FR	Vetrotech Saint - Gobain
Thermally Toughened Borosilicate Safety (EN 13024)	Integrity	Pyran S	Schott
Heat Soaked {Modified} Thermally Toughened Soda Lime Silicate Safety (EN 14179)	Integrity	Vetroflam Pyroswiss	Vetrotech Saint - Gobain
Modified Toughened Soda Lime Silicate Safety (EN 12150)	Integrity	Pyrocet Pyrocet XP (T), (S), (R) Pyrosec 19	Promat
		Pyroguard T	Pyroguard
		Pyroclear Pyroclear Plus	Pilkington
		Vetroflam Pyroswiss	Vetrotech Saint-Gobain
Resin Laminated (EN 14449)	Integrity	Pyroguard Impact Pyroguard Maxi Pyroguard	Pyroguard
Modified Toughened Laminated (EN 14449)	Integrity	Pyroswiss Stadip Vetroflam Stadip	Vetrotech Saint - Gobain
		Pyroclear Laminated Pyroclear Plus laminated	Pilkington
		Pyroguard T VF	Pyroguard

SECTION 3:

Fire-Resistant Glass

Table 2: Glass types continued

Glass Type (relevant EN product standard in brackets)	Fire-Resistance	Trade Name	Manufacturer For FRGG suppliers, see Appendix A
Laminated Intumescent (EN 14449)	Integrity	Pyrobelite	AGC
		Pyrodur Pyrodur Plus	Pilkington
Gel Laminated (EN 14449)	Integrity	Contraflam Door Lite Contraflam Lite Contraflam Structure Lite	Vetrotech Saint-Gobain
		Pyroguard T	Pyroguard
Laminated Intumescent (EN 14449)	Integrity & Insulation	Pyroguard T	Pyroguard
		Pyrobel	AGC
		Pyrostop	Pilkington
		Pyranova	Schott
		Systemglas	Promat
Gel Laminated EN 14449	Integrity & Insulation	Systemglas F1 Promaglas F1	Promat
		Contraflam Contraflam Structure	Vetrotech Saint-Gobain

Each glass type has its own characteristics, which can give rise to significant differences in fire behaviour.

Fire performance depends on the glass type and the fire-resistant glazed system design and construction. Also, the approved fenestration layout and glass pane sizes generally vary according to the particular approved glazed system being considered.

SECTION 3:

Fire-Resistant Glass

2. Performance in the event of fire

The list below provides a general description of the performance of various types of glass offered by GGF members.

Wired

The glass fractures and the integral wire mesh holds the glass together to maintain the integrity performance.

Ceramic

The glass has a near zero thermal expansion coefficient and a very high softening point, which maintains integrity performance.

Heat Soaked Modified Thermally Toughened Soda Lime Silicate Safety

The toughening process develops high stresses, and these retain the integrity of the glass on exposure to fire.

Modified Toughened Soda Lime Silicate Safety

The toughening process develops high stresses, and these retain the integrity of the glass on exposure to fire.

Resin Laminated

The integrity of these types of glass is achieved through the use of a resin-based interlayer formulated to have resistance against fire and flaming.

Modified Toughened Laminated

The toughening process develops high stresses and these retain the integrity of the glass on exposure to fire.

Thermally Toughened Borosilicate Safety

These glass types remain intact due to its composition and low thermal expansion to provide the required integrity performance.

Laminated Intumescent

These types of glass have an intumescent interlayer(s) formulated to turn opaque and swell on exposure to fire and provide the required fire-resistance performance.

Gel Laminated

These types of glass have an intumescent interlayer(s) formulated to turn opaque and swell on exposure to fire and provide the required fire-resistance performance.

3. Fire-Resistant insulating glass units

Insulating glass units (IGUs) do not offer fire-resistance unless they incorporate one or more of the types of fire-resistant glass shown in Table 2 and have been fire performance tested. The GGF provide industry guidance to insulating glass unit manufacturers regarding their compliance with EN1279 and the relevant attestation levels for fire-resistant IGUs.

Important considerations are that:

- The IGU must have its own fire test or assessment report based on test evidence
- In some cases, it must be possible to confirm the direction of use before installation
- The components used in the IGU must be proven by test or assessment the fire-resistant glazing system must be appropriate for the application of the IGU, e.g. drained and ventilated for use in external façade applications

In all cases, the manufacturer/supplier must be consulted for evidence in support of the fire-resistant glazed system. Special glass units containing integral Venetian blinds may also be available fire rated.

4. Horizontal and inclined glazing systems

Fire-resistant glazed systems are most often used in a vertical orientation. However, there are some specialist approvals available for application in the sloped and horizontal orientations, including fire-resistant floor constructions (covered in section 8 of this document).

Best Practice Rule No. 3

Never assume that a vertical fire-resistant glazing system can be used either horizontally or inclined.

SECTION 3:

Fire-Resistant Glass

A number of manufacturers have tested and approved systems available for both internal and external applications. These structures must also be able to withstand the imposed loads defined in BS NA EN 1991-1-1: UK Actions on structures. General actions. Densities, self-weight, imposed loads for buildings.

Specific details must be obtained directly from the manufacturer/supplier of the system.

5. Decorative treatments on glass

It must not be assumed that decorative effects can be applied to all types of fire-resistant glass without affecting fire-resistance. Some types of glass may be decorated with surface treatments, e.g. sandblasting, screen printing, without impairing their fire-resistance performance. Others cannot be surface treated. In all cases, specialist advice of the manufacturer/supplier must be obtained to ensure that the proposed treatment is appropriate and that relevant evidence of performance is available.

6. Combining other performance requirements with fire-resistant glazing

Other performance requirements may be readily integrated into the fire-resistant glazing system specification without compromising fire-resistance performance. This is an increasing requirement as buildings become more complex and the building environment more demanding. This can include a range of different functions (e.g. thermal insulation, safety and security, decoration and privacy).

Because of their use in escape and access routes, impact safety and manifestation (i.e. to minimise the risk of people inadvertently walking into a glass partition) are particularly important additional performance requirements.

Summary of additional functions that may be combined with fire-resistance

- Impact safety, reference BS 6262 and EN 12600 (see Appendix B)
- Containment (or barrier loading), as referenced in the appropriate, country-specific building regulation
- Thermal insulation - low emissivity energy saving and insulating glass units, are Referenced in the appropriate Building Regulations
- Solar control
- Manifestation (see Appendix C)
- Privacy (e.g. blinds etc.)
- Acoustic (sound) insulation
- Decorative, pattern and colour effects
- Resistance against forced entry **
- Explosion and bullet protection **

** (only available when relevant test evidence exists; in addition to certification for fire-resistance)

For details of the additional functions that can be provided with fire-resistant glass, please check with the manufacturer or supplier.

SECTION 4:

Fire-Resistant Glazing Seals

Section Contents:

1. Importance of the glazing seal
2. Function of the seal
3. Available forms of seals
4. Intumescent seal types
5. Non-intumescent seal types
6. Seal combinations with different glass types

1. Importance of the glazing seal

Glazing seals play an important role in fire-resistant glazed systems. They are an essential part of the system, and selection of the appropriate glazing seal is influential in ensuring that the performance capability of the full assembly is achieved under fire conditions.

An incorrect choice of seals may cause premature failure. The seal must be capable of withstanding the temperatures experienced in fire without igniting, degrading catastrophically or losing strength and adhesion.

The following key rules apply:

- The seals must be compatible with the other system components, especially the fire-resistant glass
- There must be appropriate evidence of fire performance of the glazed system in all cases
- One seal must not be substituted for another without such appropriate evidence.

Suitable seals can be either intumescent or non-intumescent based and are available in a variety of forms.

2. Function of the glazing seal

The combined functions of the glazing seal are as follows:

- Bedding the glass against the retaining bead and minimising the probability of uneven point loading or edge stresses (which can be critical for special toughened glasses, for example)

- Sealing the gap between the glass, the bead and the edge of the frame to prevent the penetration of hot gases and flame
- In the case of intumescent seal types, providing additional protection to the top of a timber bead to lower the risk of bead ignition – a benefit that comes at the expense of gap sealing performance; therefore, both intumescent and non-intumescent seals have been developed for use with integrity-only glass types for both 30 and 60 minute applications.

Best Practice Rule No. 4

Standard non-fire rated glazing seals must not be used in fire-resistant glazing systems. Always use seals that have the appropriate evidence of fire performance

3. Available forms of seals

A variety of different forms are available, as follows:

- Preformed rigid strips which are normally encapsulated with PVC for protection and decorative coloured effects
- Self-adhesive preformed flexible strips available either in coils or cut to standard lengths
- Preformed rigid channels encapsulated by PVC, or preformed rubber channels, which are fitted around the outside edge of the fire-resistant glass as gaskets
- Mastic compounds available in cartridges, of modest expansion; the use of which must be rigidly in line with the manufacturer's glazing instructions
- Fibre gaskets or woven tapes of mineral fibre
- Encapsulated cellular seal foam strip for specialist applications only with only certain glass types and only when clearly specified.
- Intumescent foam tape roll

SECTION 4:

Fire-Resistant Glazing Seals

4. Intumescent seal types (see summary in Table 3)

Intumescent seals are based on materials that expand and foam on exposure to heat. The degree of intumescence and the expansion pressure vary according to the material and its formulation. Sodium silicate, expandable graphite and ammonium polyphosphates materials are available; all of which require different glazing techniques. Therefore, the test data should be consulted, and the product installed in accordance with manufacturers' instructions.

Intumescent seal strip materials may need to be protected if they are composed of a material that is not particularly sensitive to moisture and they will generally have a self-adhesive layer to fix to the bead.

Seal combinations with different glass types

Due to the specialist nature of fire-resistant glasses; particular attention needs to be given to details when selecting seal types, and glazing details, such as edge cover, expansion allowance, bead size, shape and fixings, etc. Therefore, the selection of a compatible seal is critical. As a result, it is advised that manufacturers' test evidence or third party certification be sourced; for example

<https://www.warringtoncertification.com/certifire/glass-and-glazing/glass.html>

<https://www.warringtoncertification.com/certifire/intumescent-seals-and-smoke-door-seals.html>

Table 3: Summary of intumescent seal types

Seal Material	Trade Name/Manufacturer	Type
Sodium Silicate	Pyroglaze Mann McGowan	Liner
Ammonium Phosphate	Fireglaze G30 Sealmaster	Strip
	Firestrip 30 Hodgson	Strip
	Pyrostrip 300 Mann McGowan	Strip
	Therm-A-Strip Intumescent Seals	Strip
	Therm-A-Glaze 45/60/90 Intumescent Seals	Strip
	Pyroglaze 30 Mann McGowan	Strip
	Pyroglaze 60 Mann McGowan	Strip
Graphite	Pyroglaze FGSA Mann McGowan	Strip
	Pyroglaze Liner Mann McGowan	Strip
	Therm-A-Glaze 30 Intumescent Seals	Strip
	Fireglaze Tape Sealmaster	Strip
	Intumescent Foam Glazing Tape Sealmaster	Strip
	Promaseal PL Promat	Strip
Vermiculite	ISL 60 Plus Intumescent Seals	Strip

SECTION 4:

Fire-Resistant Glazing Seals

5. Non-intumescent seal types (see summary in Table 4)

These seal types are composed of materials that are either non-reactive when exposed to heat (such as mineral fibre products) or those which show only minimal or modest expansion. Because of this; manufacturers - or third party - test evidence must be followed.

Table 4: Summary of non-intumescent seal types

Seal Material	Trade Name/ Manufacturer	Type
Mineral or Ceramic Fibre	Black Glazing Tape Sealmaster	Strip
	Fireglaze 2000 Sealmaster	Strip
	Firetape Hodgson	Strip
	Pyrotape Mann McGowan	Strip
Elastomeric Gasket	Pyroglaze Channel Mann McGowan	Channel
Ablative Seals	Intuglaze Hodgson	Mastic
	Fireglaze Compound Sealmaster	Mastic
	Fireglaze GL60 Liner Sealmaster	Mastic
	Therm-A-Line Liner Intumescent Seals	Mastic

This is less of a problem with steel or aluminium systems compared with timber systems, but it is particularly acute for larger panes in timber frames, although there have been some successful tests in timber for 30 minute applications. In view of such factors, great care must be taken to make sure that the correct seal is used in conjunction with modified toughened glass.

In timber frames, both insulation and partial insulation

glass types perform well because the surface of the non-fire side immediately adjacent to the glass is protected against direct radiant heat for the period that insulation is maintained. These glass types are able to function with most types of seals for 30 minute applications. However, 60-minute applications may still be a problem if the seal does not prevent flame penetration around the glass edge between the timber bead and the glazing aperture in the case of doors, or between the bead and the frame in the glazing rebate for screens.

For 60 minute applications it is necessary to consider carefully the various approved applications provided by the seal manufacturers. Some products have been tested in fully glazed doors (e.g. pattern 10) for 60 minutes, while others may only have approval in small panes.

Glazing for 60 minute applications using timber beads is much more difficult than for 30 minutes, and individual seal manufacturers must be consulted to establish the range of their test evidence. The importance of this cannot be over-emphasised because. Whilst some glass products work exceptionally well with some seal systems, it cannot be assumed that all combinations work in the same way.

For 60 minutes performance in timber, a lining strip is normally fitted around the whole glazing aperture rebate under the beads. The purpose of this lining is to prevent failures from occurring as a result of fissures in the beads lining up with fissures in the door core or frame. Any holes from the inside of the assembly through to the outside will result in immediate failure.

It is imperative that the glass, glazing seal, retaining bead and its fixings all work together as a glazed system. Individual components must not be changed without checking that the performance of the system remains unaffected. Appropriate evidence of performance must always be provided

SECTION 5:

Timber Screens and Doors

Section Contents

1. Behaviour of timber in fire
2. Timber density
3. Particular considerations concerning timber fire doors
4. Timber glazing beads
5. Additional information concerning glazing beads used in timber fire doors
6. Bead fixings
7. Setting blocks
8. Integrity and insulation glazing with timber fire-resistant systems
9. Glazing apertures in doors
10. Linings for glazing apertures
11. Particular considerations to achieve 60 minutes integrity performance in timber glazing systems
12. Particular considerations for 60 minute fire doors
13. Fanlights

1. Behaviour of timber in fire

Timber chars and possibly flames under fire conditions at a rate and to an extent of deterioration that depends on several interacting factors:

- The intensity of exposure to radiant heat flux or flame
- The time of continuous exposure
- The density, grain structure and moisture content of the timber

As a rule for fire safety designers, non-piloted ignition (“spontaneous” or “auto ignition”) does not generally occur unless radiant heat intensities reach the range 25kW/m² to 33kW/m². Under piloted (i.e. naked flame) ignition, flaming can occur at lower intensities of 12kW/m² to 13kW/m².

As timber shows limited expansion in a fire, timber screens and doors generally do not induce significant

mechanical stresses in adjacent constructions.

Both 30 and 60 minute timber systems therefore need to be carefully designed because of this degradation. The type of timber, section thicknesses, fixings, and bead shapes must all be specified in detail. Where 60 minute timber fire screens and doors are required, additional detailing will be needed because of the increased fire exposure time.

2. Timber density

The type of timber and its density is a key factor which determines the rate at which timber chars and degrades under fire conditions. The grain density and straightness of the grain also exert an effect in terms of the degree to which twisting may occur in the event of fire.

Timber is a naturally occurring material and a certain amount of natural variation in properties, especially density, can occur.

The following information can be taken as general guidance for the charring rates of timber:

- Hardwood timbers used in fire-resistant glazed systems, generally have densities more than 630 kg/m³, with typical char rates in the order of 0.5mm per minute e.g. Sapele, Iroko or Dark Red Meranti – note exceptions below
- Softwood timbers used in fire-resistant glazed systems generally have densities more than 480 kg/m³, with typical char rates of around 0.7mm per minute e.g. European Redwood.

However, there are some exceptions:

- Certain temperate-zone hardwoods e.g. ash and beech demonstrate burning characteristics atypical to those for other hardwood timbers. Fire test evidence or third-party assessments should be referred to prior to specifying timber species, to ensure performance.
- Some softwoods e.g. Douglas Fir, with densities lower than 480 kg/m³, which char faster than 0.7mm per minute must therefore be used in larger sections to achieve the required fire-resistance period – see note above

SECTION 5:

Timber Screens and Doors

Key factors determining the performance of timber glazing systems

- Type of glass: Integrity only, Partial or Fully Insulating
- Type and density of timber
- Size of sections and cross-section dimensions of frame
- Depth of glazing rebate
- Size, shape and design of glazing beads
- Type of fixings of the beads, their location and angle of fixing relative to the type of glass
- Edge cover and clearances for the different types of fire-resisting glass (especially for modified soda-lime silicate toughened glass)
- Type of glazing seal
- Nature of any timber treatment required
- Compatibility of all components
- Method and materials used to fix the frame to the surrounding structure, e.g. walls
- Fire stopping between the fire-resistant screen or door frame and wall
- Internal or external position
- Requirements for doors within screens
- Availability of fire test or third-party assessment evidence to support detailed specification
- Installers capability regarding fire-resistant glazing and availability of trained and certified personnel

3. Particular considerations concerning timber fire doors

A timber fire door is a carefully designed and engineered product that has far more to do than simply filling a hole in a wall or partition (see Figure 4).

Fire doors are fundamental to the escape and access strategy for fire safety in buildings, and they must function correctly as a fire barrier. It should be noted the size, position and aspect ratio of the glass is critical. Fire test evidence or third-party assessments must be submitted to support the glazing specification.

A fire door comprises the door leaf, door frame,

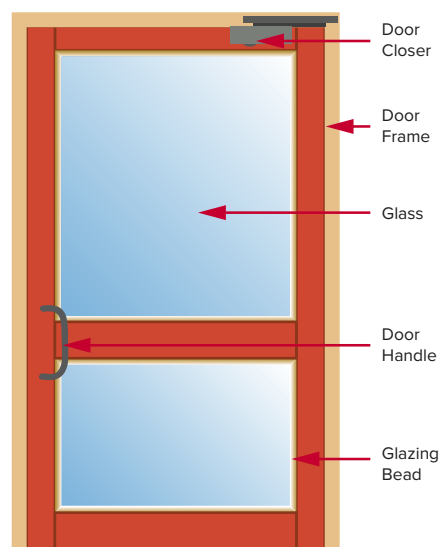


Fig 4 – Example of 30 minute timber glazed door

hinges, associated ironmongery, intumescent fire and cold smoke seals and the glazing system in any vision panels.

These components must all work together to ensure that the completed door assembly functions correctly in the event of a fire.

To ensure the fire performance of the door is achieved, the manufacturer's instructions concerning assembly and installation must be followed correctly.

As a general guide, door thicknesses are generally at least 44mm for 30 minute ratings and 54mm for 60

SECTION 5:

Timber Screens and Doors

minutes. The individual components of a door assembly must not be changed from those specified within the fire test report. Check substitution under Certifire, QMARK or BWF CERTIFIRE.

4. Timber glazing beads

Additional factors influencing fire-resistance performance

Door Leaf

- Single leaf or double leaf, single action or double action, latched or unlatched
- Thickness and construction, i.e. core material, sub-facings, facings and lippings
- Type of timber and nature of any timber-based products that may have been used
- Width and height of door leaf

Glazing Aperture

- Size and shape of aperture
- Unless tested, the glazing aperture must not cut through internal stiffening elements within the door
- Location of glazing aperture, especially relative to door edge perimeter
- The distance between apertures
- The layout of multiple apertures
- Preparation and “finish” of any apertures, especially corners
- Methods and materials used to line the aperture

Glazing System

- Size and section of glazing beads
- Trimming and jointing of glazing beads
- Glazing materials, i.e. intumescent glazing seals, liners, etc

- **Position, length and direction of fixings (screws/pins)**

General

- Proper application of smoke seals; if appropriate
- Door furniture: hardware, such as closers, latches and hinges and their suitability for use on fire doors
- Door frame and support structure
- Surface finishes and treatments
- The intumescent sealing system in the door leaf, door frame, ironmongery protection and frame-to-structure gaps

The glazing beads are the smallest section of timber in a fire-resistant glazed system, and therefore the species of timber used for the bead, the bead thickness, bead shape, size and method of fixing are all critically important in achieving the required fire-resistance performance. This is particularly important for integrity-only glazed systems.

The bead section size and shape should both be sufficient to ensure that there is enough residual timber remaining at the end of the fire-resistance period to ensure integrity of the glazed aperture and to prevent failure of the screen or door. Fire test or third-party assessment evidence should be consulted when determining the bead specification.

When a clear integrity-only (non-insulation) glass type is used then there is a risk of bead ignition on the unexposed face due to transmitted radiant heat. A traditional design feature to reduce this risk is to chamfer the top of the bead (instead of having a square bead) to minimise the exposed surface area and the radiant heat intensity on the top of the bead. Test evidence is required for the glass type, bead detail and glazing sealant combination. Such approved glazed systems are available, and the door/screen manufacturer/supplier must be contacted for specific details. The top of a timber bead may be

SECTION 5:

Timber Screens and Doors

successfully protected by using an insulation rated fire-resistant glass.

Note:

- If the bead or their fixings fail prematurely, the glass will fall out of its aperture
- The glazing pocket must be protected against leakage of hot gases from the exposed side, which could penetrate around the glass edge and scour out the glazing pocket
- For a non-intumescent integrity-only glass, the use of an appropriate intumescent glazing material helps to seal any gaps that develop between the glass and the bead
- An intumescent glazing seal may also swell sufficiently to mask or protect the face and top of the bead from radiant heat (see Section 4)
- Laminated integrity-only fire-resistant glass types that reduce the radiant heat transmitted provide a greater margin of safety by minimising the risk of bead ignition on the unexposed side
- Insulation with integrity glasses (i.e. EI class) significantly reduce the risk of bead ignition by preventing significant heat transfer to the non-fire face by radiation
- Glazing rebates which are part of the solid frame should always have identical mechanical fixings as the removable beads

Examples of timber bead types and intumescent seals

Timber beads used in fire-resistant glass doors and screens can be of various designs and can be used with different intumescent seal systems.

Timber screens and doors may be manufactured with either flat glazing platforms or rebated glazing platforms. Figure 5a shows flat glazing platform options and Figure 5b shows rebated glazing platform options.

The following show the more common types and the combinations allowed will be shown in the appropriate test/assessment report.

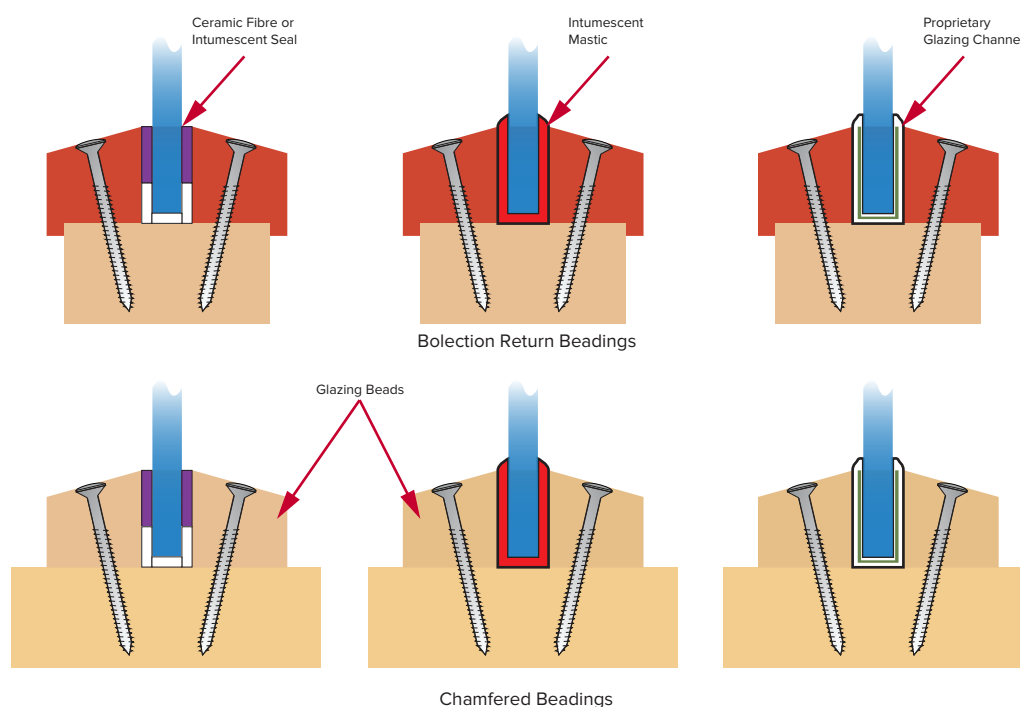


Fig 5a – Examples of different types of bead used with flat glazing platform

SECTION 5: Timber Screens and Doors

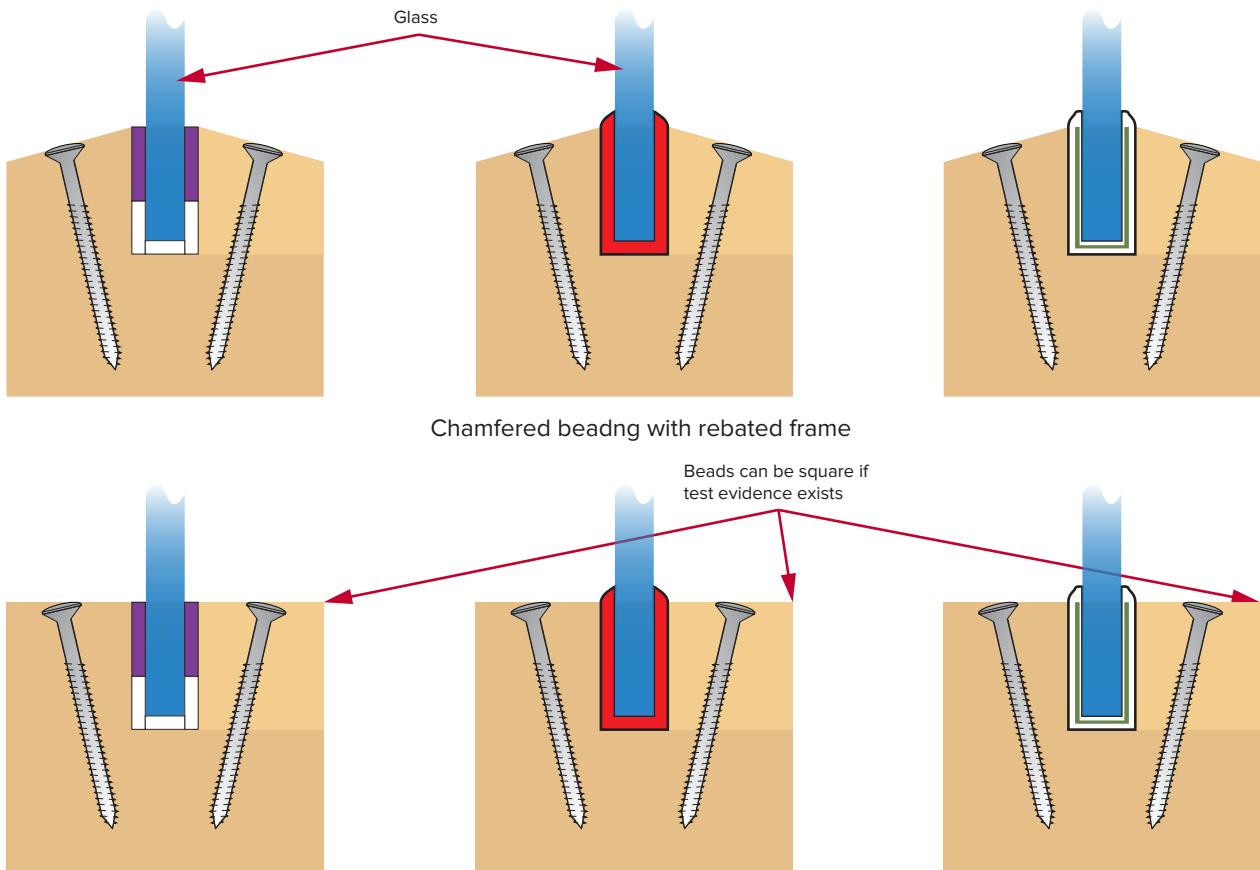


Figure 5b – Examples of different types of bead used with rebated glazing platform

5. Additional information concerning glazing beads used in timber fire doors

Beads used for fire doors require additional considerations to those used for screens in view of the door leaf construction:

- The glazing beads may need to be of a higher density than that used in the main door construction
- Circular apertures in fire doors may need a steeper splayed chamfer than normally used for rectangular openings

6. Bead fixings

The bead fixings are critical to the successful performance of a fire-resistant timber glazed system.

The function of the bead fixings is to keep the glass in

place in the frame should the beads burn away.

Best Practice Rule No. 5

When glazing fire-resistant Toughened Soda Lime Silicate glass into timber, take particular care to ensure that edge cover stipulations from the manufacturer/supplier are met and the glazing seal is exactly as specified.

The following factors are key to the successful performance of the system:

- Screws, nails or pins may be used, provided that the material and gauge is sufficient to give the required fire-resistance performance when tested

SECTION 5:

Timber Screens and Doors

- Fixings are usually angled towards the centre of the frame
- The length of the fixings should be sufficient to ensure sufficient penetration into the sub-frame to give a secure fixing (typically at least 38mm for 30 minute performance and at least 50mm for 60 minutes)
- Particular care must be taken if air gun pins are used, to ensure that the supplied evidence supports the use of these components, as pin gauge and angle of application are particularly critical for this fixing type
- The distance between the fixings must be as shown in the supporting evidence (fixing centres typically start at a maximum 50mm from the aperture corner and thereafter are spaced with a maximum separation of 150mm)
- It is good practice to stagger fixings on each side of the glass to ensure fixings are not directly opposite each other and prevent fixings for interfering with those on the other side
- The frame must be sufficiently robust to secure the fixings in the event of fire (especially relevant for timber doors)

7. Setting blocks

The supplier's recommendations concerning the type of material, thickness, location and positioning of the blocks must be followed for the particular glazing system being installed.

Setting blocks are required to locate the glass correctly in the glazing aperture so that fitting tolerances and expansion allowances can be accommodated. The type of block must be specified.

Best Practice Rule No. 6

Glazing blocks must always be used as directed to ensure correct expansion provision, appropriate glass edge cover and positioning of the fire-resistant glass within the frame.

In the case of timber doors, the use of setting blocks leaves a gap between the edge of the glass and the internal base of the cut-out, which may not be sufficiently sealed by beads or glazing seal strips.

This may be acceptable subject to fire test evidence. Where hot or cold sealing is also required, special attention to this aspect of design will have to be given. It is very likely that the gap will require sealing.

Best Practice Rule No. 7

Glazed panels must only be installed in doors that are appropriately tested. Glazing apertures must never be cut in doors that are not designed to take such apertures.

8. Integrity and insulation glazing with timber fire-resistant systems

Using an integrity and insulation rated glass significantly reduces the possibility of bead ignition and therefore the detailing of the bead is much less significant in terms of overall fire performance compared with the requirements for integrity glass. The use of chamfered beads with these glass types is no longer a concern. The use of any shaped or moulded beads, for reasons of style and design, are possible provided there is suitable fire test evidence.

However, attention to the fixings of the beads and their location is still very important in order to keep the glass in its aperture.

Note:

UK Building Regulations require doors to have a smoke control function in certain locations, designated with an "S".

e.g. FD30S = 30 minutes integrity fire door with smoke control.

When using insulating glass - especially for 60 minute fire resistance - the design of the frame section must be able to support the additional weight of the glass compared with integrity only glasses. The design must also take into account the reduction in timber strength that will occur due to the charring of the timber during the fire.

SECTION 5:

Timber Screens and Doors

9. Glazing apertures in doors

The cutting of an aperture within a door leaf can weaken its core by removing some key structural components. This can severely prejudice fire performance.

Therefore:

- The original door design template must include the provision for glazed apertures of the type, layout and shape being considered
- Apertures must be formed as part of the door manufacturing process under factory controlled conditions according to manufacturer's instructions (and not cut out at a later stage as a secondary operation on a completed assembly or on site)
- Modular glazing kits may only be used if this is approved with the door design
- For 30 minute doorsets, glazing of the aperture may be conducted on-site using the correct materials and specification according to the supplied test evidence
- For fire-resistance periods of 60 minutes or longer, it is recommended that the doors be purchased complete, i.e. factory-glazed
- For rectangular apertures, any glazing gaskets must be properly mitred at the corners in line with manufacturer's instructions
- Rectangular apertures must not be replaced by circular or non-rectangular apertures of the same area without test or assessment evidence
- The glazing seal for any curved or circular apertures must be capable of being formed to fit the required curvature without splitting. This is particularly relevant when using pre-formed channel type gaskets but is less of a problem when strip type gaskets are used as these are flexible and can, if necessary, be easily butt-jointed below the bead line
- Similarly, a hardwood lining fitted in straight lengths will have to be replaced by an alternative

method for curved cut outs

A particular door leaf design will have a maximum permissible size of glazing aperture based on full-scale test evidence on that specific door construction.

It must not be assumed that this maximum approved size may be automatically applied to another door leaf construction. Each door assembly requires its own specific test evidence, or assessment evidence related to test data. This also applies to glazed screens.

Multiple apertures are only allowed if the door assembly under consideration has the appropriate test or assessment evidence.

10. Linings for glazed apertures in timber doors

Protective lining of the glazing cut out will be necessary for those door leaf constructions using low density core material, if either or both:

- The core material is not able to secure the glazing bead or glazing channel fixing sufficiently securely in the event of fire
- The unprotected exposed core material does not have sufficient resistance to erosion by fire once the beads have burnt away

Any lining that is used must be located tightly into aperture corners.

When fire erosion is a potential problem, a hardwood lining of satisfactory material is usually required. This will normally be a minimum of 6 - 8mm thick and a minimum density of 630 kg/m³. These linings are usually essential for 60 minute and above fire resistance.

For aesthetic reasons, it may be acceptable to use solid timber linings that are visible on the front of the door. These are usually built-in during the manufacturing process.

Particular considerations to achieve 60 minute integrity performance in glazing systems

SECTION 5:

Timber Screens and Doors

At 60 minutes fire exposure, the glazed system will have seen significantly higher temperature and radiant heat intensities when compared with 30 minutes fire exposure. Additional factors have therefore to be taken into account in designing these systems:

- Larger sections and more secure fixings at closer centres are needed to compensate the accelerated and more extensive fire erosion of the timber sections
- Different types of seals are required to minimise the possibility (in particular) of soda-lime silicate glass types slumping out of the frame or door aperture
- An intumescent rebate liner is necessary to reduce the passage of hot gases around the glass edges due to erosion of the beads, and prevent undercutting of the glass in the glazing pocket
- The use of a laminated integrity glass with an enhanced performance in reducing radiant heat or a fully insulating glass type to eliminate the risk of flaming of the beads on the unexposed side

The purpose of an aperture rebate lining material is to prevent failures from occurring as a result of fissures in the beads fortuitously lining up with fissures in the door core or frame. Any holes from the inside of the specimen to the outside would result in immediate failure.

Note:

The width of beads used to glaze modified toughened soda-lime silicate fire-resistant glass types can be increased but, the height must not exceed any stipulated edge cover plus tolerance requirements, normally a maximum of 10mm + tolerance.

11. Particular considerations for 60 minute fire doors (FD60)

The achievement of a 60 minute (or greater) fire-resistance performance requires particular attention to detail in the door structure, materials and the glazing system design and components.

Intumescent or non-combustible ceramic fibre liners are usually necessary for apertures, in addition to any timber liner that is normally required.

The function of such liners is to inhibit the permeation of hot gases, volatiles or flames through the door leaf, or around the glazing system, to the non-exposed face. Erosion of the exposed face as a result of such permeation could char timber beads and undermine the glazed system's intumescent seal.

This is required to prevent integrity failure, even though the glass and its glazing system may remain in place.

12. Fanlights

Fanlights are glass apertures that are located directly above a door. This type of glazing is usually incorporated within the door assembly by extending the door frame height and building in a transom. The transom acts as both a door frame head to locate the top edge of the door leaf and as a bottom supporting element for the fanlight glazing arrangement.

Note: Fire test or third-party assessment evidence must be available to cover fanlights.

System or Trade Name	Fire Resistance Integrity/Insulation	Additional Comments	Manufacturer
Pyrovista	30/0	Glazed Screens	Mann McGowan
	30/30		
	60/30		
Firestile	30/0	Fully Glazed Fire Doors	
	30/30		
	60/60		

Table 5 - System and Trade names of fire-resistant timber screens and doors

SECTION 6:

Metal Systems for Screens and Doors**Section Contents:**

1. Behaviour of metal in fire
2. Metal fire doors
3. Beads and fixings
4. Installation
5. Edge cover requirements
6. Key factors affecting performance
7. Curtain-walling and other Pressure Glazed Systems
8. Curtain walling systems
9. Frames for external applications (drained and ventilated systems)

1. Behaviour of metal in fire

Unlike timber, metal frames expand when heated, which can lead to flexing and twisting of the frame. This means that provision for thermal expansion is particularly important. For example, at 700°C, a 3m length of steel section will expand in length by about 25mm. If constrained, this would give a bow at mid-distance of approximately 150mm.

The fixings of the framed assembly to the supporting structure are also important; taking into account expansion allowances. The correct frequency and spacing of the fixings is a very important part of the installation

Other factors that influence performance are thermal conductivity, oxidation, loss of strength and melting. Framing options based on both steel and aluminium are possible, but fire-resistant frames must be specially designed to withstand fire safe conditions according to their required performance. Completely different framing constructions are used for steel and aluminium in view of their different thermal properties.

Metal frames must not therefore be used either for fire screens or fire doors unless suitable fire test evidence is available.

Metal framing for use in conjunction with fire-resistant glass falls into two categories:

Key factors determining the performance of metal glazed, fire-resistant systems

- Type of metal
- Integrity only or integrity plus insulation frame design
- Size of sections and cross-sectional dimensions of the frame
- Methods and materials used to fix the frame to the surrounding structure e.g. wall, floor etc.
- Fire-stopping between the fire-resistant screen and the structure e.g. wall, floor etc
- Depth of glazing rebate
- Type of fixings for the beads or other glass retaining mechanism
- Edge cover and edge clearance for the different types of fire-rated glass
- Glazing seals
- Compatibility of all components

- Integrity only
- Integrity plus insulation

The fire-resistant glass must be positioned on non-combustible setting blocks, e.g. mineral fibre board, to ensure that the glass is installed centrally within the frame rebate aperture, with the correct edge cover to the glass on all sides as specified, and to accommodate expansion and location requirements of the glass.

Metal screens**Steel**

Framed systems are available from three main sources:

- Rolled formed steel profiles, available from a proprietary systems house, manufactured and fabricated by an approved specialist metalwork

SECTION 6:

Metal Systems for Screens and Doors

fabricator

- Hot rolled steel sections, such as W20-type steel sections
- Standard steel sections, formed in many different configurations by individual manufacturers to their own specifications and proprietary designs.

Steel profiles are typically 1.5-2mm thick, and either hot-rolled or cold-formed from strip. Each system supplier or fabricator will have their own fire test evidence based on proprietary steel profile sections, giving the maximum pane size for each glass type, glazing material used, type of glazing bead and the spacing of the bead fixings.

Steel-framed glazing systems are capable of providing fire-resistance performance for both integrity-only or integrity and insulation and ratings from 30 minutes up

Best Practice Rule No. 8

Integrity frames must not be used for insulation applications and all components must be compatible under fire conditions.

to 120 minutes.

Over-clad steel systems are possible, containing steel as the main fire-resistant structural elements with aluminium, stainless steel or other capping material for appearance or style. These systems are not as common as proprietary systems, and care should be taken to ensure their suitability and certified fire-resistance.

Aluminium

There are a number of proprietary fire resistant systems available from specialist suppliers and fabricators based on extruded aluminium profiles. The internal structure and make-up of these systems is specialised and dependent on the supplier's specific proprietary designs. Specialist installation techniques are also required.

Aluminium systems are therefore normally available only on a supply and fit basis and should only be used

if suitable fire test evidence exists.

Composite systems

Such systems are produced from a combination of materials such as fire-resistant calcium silicate boards either side of a steel core, with a variety of covers on either side. But in all cases, only proprietary systems with the necessary evidence of performance must be used.

Timber and metal combinations behave differently when exposed to heat from a fire and therefore require special design expertise

2. Metal fire doors

- The whole door assembly, including the glazing and all associated components, must have relevant and applicable evidence of performance.
- A metal door must not automatically be assumed to be fire-resistant; and the conversion of non-fire-resistant metal doors should not be carried out or encouraged. Only door systems specifically designed for fire-resistance may be used where fire-resistance is a requirement of the specification.
- Care needs to be taken to ensure that critical elements of door hardware are positioned in accordance with their test evidence. The main features of metal fire doors are summarised in Figure 7.

SECTION 6:

Metal Systems for Screens and Doors

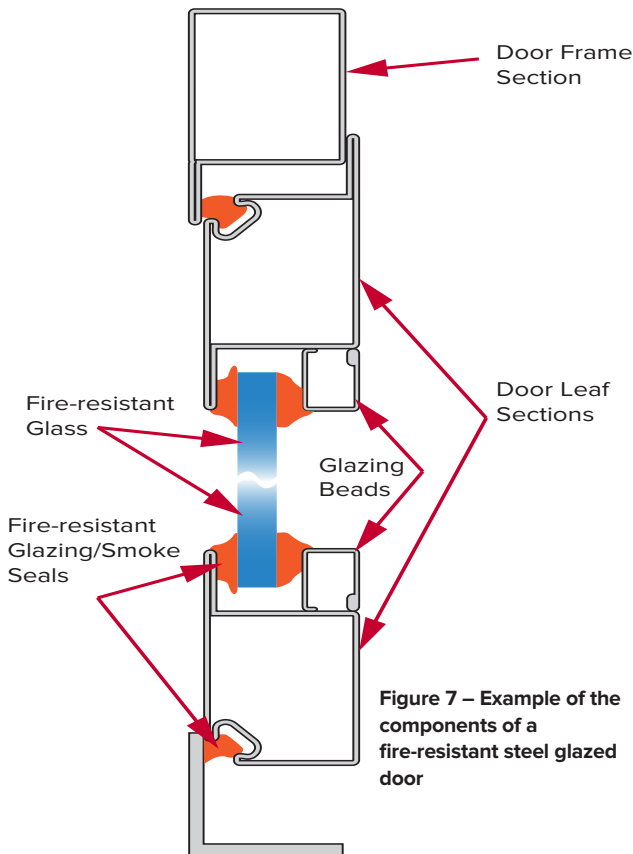


Figure 7 – Example of the components of a fire-resistant steel glazed door

3. Beads and fixings

Glazing beads for metal systems are available in various forms such as angles, specially formed channels or box sections which may be fixed with either screws, bolts, studs or clips; depending on how the system was previously tested. The most popular are snap on beads locating on studs.

Fixings generally offer a 20mm deep glazing rebate with the screws, bolts or self-drill/screw studs spaced at approximately 250-300mm centres.

The glass must be retained in one of two ways: either steel pressure plates or with a profiled metal glazing bead.

4. Installation

Fire-resistant metal screens and/or doors must be fitted into a suitably sized opening, with supporting structure, which achieves at least the same level of fire performance as the fire-resistant element. The frame and its fixings must also support the weight of the glass.

The approved fire-resistant assembly must be attached using fixings which are not affected by the heat of the fire, such as steel fixings and shims, brass screws and plastic shims should never be used.

Any gap between the frame and structure must be

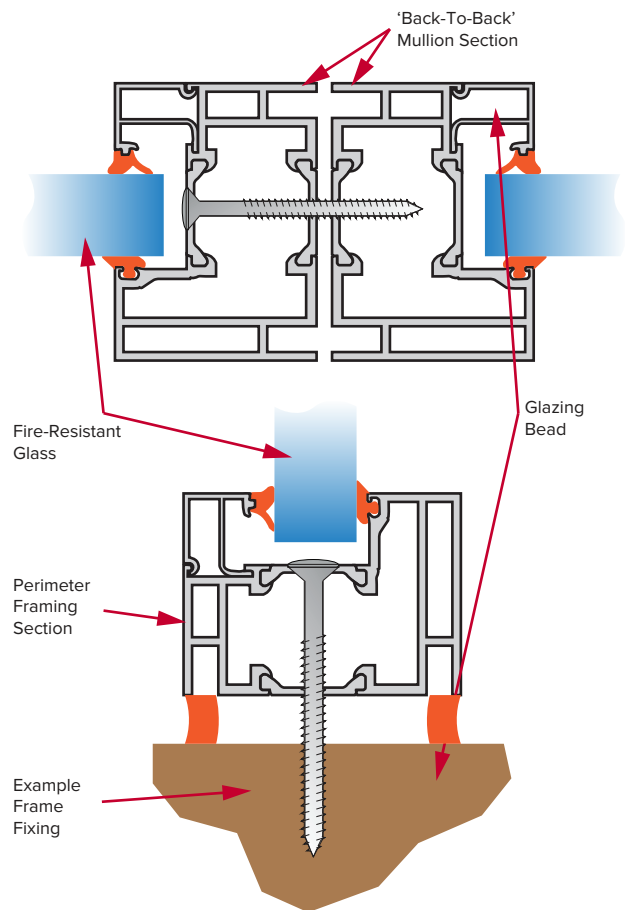


Figure 8 – Examples of non-insulating fire-resisting framing sections

filled with suitable fire-resistant packing, e.g. compressible mineral fibre wool, which is generally covered with a fire-resistant silicone seal. Careful consideration must be given to the detail such that the required thermal expansion for the full assembly is not inhibited.

SECTION 6:

Metal Systems for Screens and Doors**5. Edge cover requirements**

Most metal framed systems offer a 20mm deep glazing rebate suitable for the majority of fire-resistant glass types; however, some fire-resistant glass types may require a reduced glazing rebate depth.

Glazed systems in applications where resistance against crowd pressure is a requirement should comply with the requirements of BS 6180.

Note: Always follow the supplier's specific glazing instructions regarding any guidance or limitations on edge cover.

6. Key factors affecting performance**Integrity**

Metal frames for integrity only ratings serve principally to retain the glass in position to prevent the penetration of flames and hot gases. An example is given in Figure 8.

Integrity-only systems must be designed with bowing particularly in mind because of the temperature differential between the hot and cold sides of the frame which can cause bowing due to differential expansion (normally convex towards the fire side).

This may, for example, require the use of a flexible glazing seal to minimize and evenly distribute any edge stresses that result.

Similarly, expansion allowances must be provided as specified for the frame within the opening of the supporting construction. These requirements must be followed on installation.

Fire-resistance performances of 60 minutes and longer are commonly available, but normally require attention to the following:

- Bonding of the glass along the top edge and usually one third down each side to prevent glass slumpage may be necessary, using high temperature non-combustible adhesives and ceramic fibre gaskets
- Measures to minimize heat transfer to the glass edges which could cause softening of the edges

(which is not normally an issue for 30 minute metal glazed systems but certainly is at longer times for non-intumescent glass types

- Design detailing to apply mechanical restraint to the glass edge, for example, through glazing pressures

Insulation


Special constructions are needed to achieve insulation performance. Each system company has its own system design based on special metal profiles. The details of system design and construction are critical in achieving adequate fire resistance.

One way of achieving this is by using internal blocks of insulation materials and particular constructions that minimise direct paths for thermal conduction, by thermally separating one face of the frame from the other. Figure 9 shows typical examples.

SECTION 6:

Metal Systems for Screens and Doors

Figure 9 – Examples of metal framing systems for Integrity and Insulation

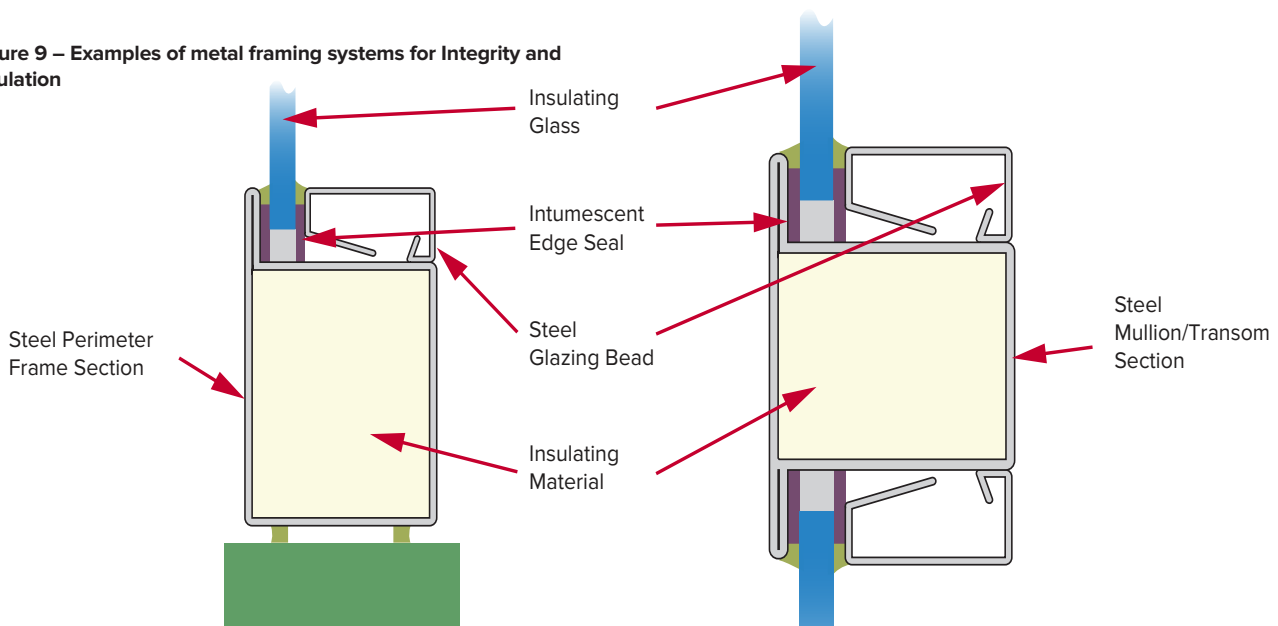

Never:

- Use any systems other than those that are designed specifically for fire-resistance and have the necessary, and relevant, evidence of performance
- Make any changes to the system as supplied
- Use insulation glazing in integrity only framed systems for insulation performance
- Use modified toughened soda-lime fire-resistant glass types in insulation rated metal framing systems (some systems have been tested with insulated glass in non-insulated frames – and vice versa – however, the performance will always be reduced to integrity-only, and not all systems and glazing are suitable for this application)

7. Curtain-walling and other Pressure Glazed Systems

Edge pressure can be applied to the glass by the tightening of screws or bolts onto steel plates, around the perimeter of the glass. Pressure glazed framing can increase the length of time that certain integrity-only glass types are retained within the frame during a fire. It is only of benefit for fire-resistance periods of 60 minutes and longer.

Pressure glazing systems

The glazing pressure is specific to the individual glass productions being used and manufacturer's stipulated guidelines must always be followed for the framing system being considered.

In general there are two types:

- Lipped channel glazing, in which pressure generating intumescent strips are fitted between faces of the glass and the inside of the special glazing channel
- Mechanical retention, the simplest pressure glazing system, which requires the use of back-to-back steel angles with pressure plates holding the glass edge in position during the latter stages of the fire

It is important with the mechanical retention design that the pressure is applied equally around the perimeter of the glass to avoid uneven loading of the glass.

Note:

- The use of angles or back-to-back angles to form a glazing rebate, does not automatically imply that the system is pressure glazed

SECTION 6:

Metal Systems for Screens and Doors

- Existing systems should not be modified to be pressure glazed because the alterations must be precise in terms of both materials and design

8. Curtain walling systems

The specimen of the system when fire tested must include all the system elements to verify its performance.

On installation, there is the potential for a gap to exist between the approved façade construction and the adjacent floor slab. Adequate fire stopping must be used to fill this gap to prevent the movement of fire, flames and smoke between floors. The supplier of the curtain wall must provide this level of detail.

Factors to consider are:

- Connections to the supporting structure and their adequacy in fire conditions
- Exposure of the curtain wall element to fire exposure either from below or above
- The linear gap between the curtain wall and any of the surrounding or supporting structure
- Any cavities that may be provided for within the curtain wall design
- The provision of appropriately fire rated spandrels between the glazed sections

Glazing seals for metal framed systems

A range of different materials may be used according to the specific glazing system. Always use the approved seal material as specified for each particular glazed system, and never substitute materials, unless approved by a competent authority and endorsed by the supplier of the glazed system.

9. Frames for external applications (drained and ventilated systems)

When using fire-resistant glazed systems in external applications the framing system must follow the normal requirements of external systems to allow any moisture that enters the frame to escape (known as “drained and ventilated” systems). This is normal practice for external glazing.

Not all fire rated glazing systems are suitable for external use, and simply drilling holes in to the system to form drainage is not an acceptable practice. External fire rated glazing is usually wet glazed, not gasketed.

System Name or Trade Name	Fire Resistance Integrity/ Insulation	Additional Comments	Manufacturer
Systemglas Ferro	EI30 – EI120	Glazed Screens	Promat

Table 6—System and Trade names of fire-resistant metal screens and doors

SECTION 7:

Butt-jointed Systems

Section Contents:

1. Types of systems
2. Perimeter framing
3. Available systems

1. Types of systems

Butt-jointed, fire-resistant glazed systems are also available to complement similar designs in non-fire rated applications. There are integrity-only systems and insulation with integrity systems (using intumescent laminates or gel-filled units). An example is shown in Figure 10.

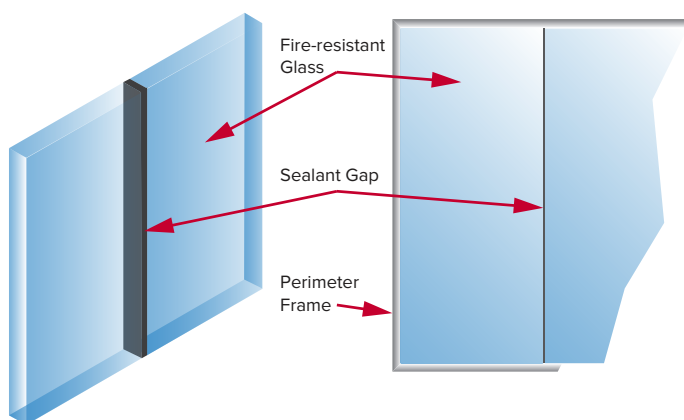


Figure 10 – Example of fire-resistant butt-joint system

In such systems, the mullions separating and retaining the glass panes are replaced by a compatible and tested system that remains in position in the event of fire to prevent the passage of flames and gases to the non-fire side. A horizontal support framework retains the glass in position at the head and sill. Vertical support work at either end of the glazed partition may also be required.

2. Perimeter Framing

The perimeter framing is a purpose-made construction that is specific to each manufacturer and is typically steel or timber. Other materials have been tested and

can be used to suit individual design solutions; this includes aluminium. Special attention needs to be taken that the correct framing design is used with these systems.

Installation of these systems – as with all fire-resistant systems – is critical to achieve the desired performance; and needs to be carried out by competence persons with experience in this type of glazing.

For integrity rating an approved integrity (E) framing system can be used and for integrity and insulation (EI) systems will be constructed using approved EI framework, both types should be designed for the appropriate fire rating, i.e. 30, 60, 90 or 120 minutes.

The minimal framing of butt-jointed systems means that the surrounding structure must be substantial enough to support the weight of the glass and the forces that the system may be subjected to. The surrounding structure must also be of equal or greater fire-resistance than the glass.

Butt joints between adjacent panes of glass are usually vertical but may be horizontal. In both cases test evidence or assessment must be available to support the design.

3. Available systems

Where a change of direction of the partition is required some systems are available to allow glass-to-glass corner joints. If no evidence is available then a corner post is usually required. Systems are also available using minimal width profiles, which are essentially decorative, covering the vertical and/or corner joints.

It is common practice to test a system with one free vertical edge to represent a continuous run of glazing. Conversely, when the perimeter frames are fixed on all four sides then it is not possible to exceed the number of panes that have been tested. For example, two panes tested with a central butt joint and a frame fixed on all four sides would not permit an installation with three panes of glass.

SECTION 7:

Butt-jointed Systems

Note:

- Specialist frameless systems have been tested from 30 minutes integrity up to 120 minutes integrity and insulation
- There must be no interchange of components between different systems otherwise the fire-resistance performance of the screen will be compromised, unless approved by the system designers/test house
- When installing insulation butt-jointed systems, all joints must be fully sealed at the time of installation; utilising the correct glazing compounds commensurate with test data
- Some insulation glass types require edge tape to protect the fire resistant interlayers. This edge tape should still be used when butt jointing the glass but is typically cut back to the corner of the glass and therefore not seen once the joint has been filled with the required sealant.

Table 7 - System and Trade names of fire-resistant frameless screens

System Name or Trade Name	Fire Resistance Integrity/Insulation	Additional Comments	Manufacturer	
Pyrovista	30/30	Timber perimeter framed system	Mann McGowan	
	60/60			
Pyrobel Vision Line	30/30		Steel perimeter framed system	AGC
	60/60			
	30/30			
Pyran S	30/0		Steel or timber perimeter framed system	Schott UK Ltd
	60/0	Steel perimeter framed system		
Pyranova 30	30/30	Steel or timber perimeter framed system		
Pyranova 60	60/60			
Pyranova 90	90/90	Timber perimeter framed system		
Contraflam Structure Lite 30 & 60	30/0 – 60/0	Timber, steel or aluminium perimeter framed system	Vetrotech Saint-Gobain	
Contraflam Structure 30 (including angle joints)	30/30			
Contraflam Structure 60 (including angle joints)	60/60			
Contraflam Structure 90	90/90	Steel perimeter framed system		
Contraflam Structure 120	120/120			
Pyroguard Infinity	30/30 – 60/60	Steel or timber perimeter framed system	Pyroguard	
Pilkington Pyroclear® Line	30/0	Steel or timber perimeter framed system	Pilkington	
Pilkington Pyroclear® Line	60/0	Steel perimeter framed system		
Pilkington Pyrostop® Line	30/30	Timber or aluminium perimeter framed system		
Pilkington Pyrostop® Line	60/60	Steel or timber perimeter framed system		
	120/120	Steel perimeter framed system		
Pyrostop® Line (including angle joints)	60/60	Timber, steel or aluminium framed systems		
Systemglas	30/30 – 90/90	Timber and steel framed systems	Promat	
F1	30/30 – 90/90	Timber and steel framed systems		

SECTION 8:

Fire-Resistant Glass Floors**Section Contents:**

1. Essential requirements
2. Fire performance requirements and testing
3. Floors
4. In service functional requirements
5. Additional functional properties
6. Systems
7. Connections and gaskets
8. External load-bearing fire-resistant floors
9. Installation

1. Essential requirements

Flooring is a load-bearing element and will often form an essential part of the escape, fire separation and compartmentation fire safety strategy of a building. It is not unusual for glass to be used in structural loading applications, and there are some special fire-resistant glass load-bearing floor constructions available (based on tested systems) that allow the designer full scope in the use of glass throughout a building to maximise the benefits of natural lighting, as well as opportunity to create eye-catching internal visual effects.

Where load-bearing glass floors are concerned, however; fitness for intended purpose is critical. It is implicit that the structure should be stable under fire exposure and that the heat transmitted through the structure should be “resistant to the transfer of excessive heat”* in order to both retain structural stability and create tolerable conditions for those who may have to travel along the floor with fire underneath. (*Approved Document B, Volume 1; section B3)

It is essential that a fire-resistant floor construction should maintain its structural stability and load-bearing capability throughout any potential fire because of the fundamental consequences for the rest of the building. In particular, as recommended by Approved Document B Vol 2 (section 8.20) every compartment floor should form a complete barrier to fire between

the compartments they separate.

2. Fire performance requirements and testing

The performance requirements recommended by AD B are given in Table A1 of Appendix A in the document. The most common requirement is for 60 minutes load-bearing, integrity and insulation, i.e. REI60 (with higher required classification times in some circumstances, especially for buildings higher than 18m). There are also some limited applications for 30 minutes classification times (load-bearing, integrity and insulation), REI30, mainly in residential buildings no higher than 5m.

Where floors are concerned, it is especially important to note the following from

Approved Document B Vol 2 Appendix A:

“Where one element of structure supports or carries or gives stability to another, the fire resistance of the supporting element should be no less than the minimum period of fire resistance for the other element (whether that other element is load-bearing or not)”.

The applicable fire test standards are BS 476-21 (“Fire tests on building materials and structures. Methods for determination of the fire resistance of loadbearing elements of construction” and BS EN 1365-2 (“Fire resistance tests for load-bearing elements.

3. Floors

The tested system should be fully representative of the proposed floor structure; and the magnitude and distribution of the load shall be such that the maximum moments and shear forces produced in the test specimen are representative of, or higher than, those expected in service.

It is important to note that the floor construction should accordingly have applicable fire test evidence under full loading conditions throughout the length of tested fire exposure. The deflection of the system is measured before the test and throughout to reflect changes in its mechanical stability as the test

SECTION 8:

Fire-Resistant Glass Floors

progresses. BS EN 1365-2 requires that the system be tested with a combination of the concentrated and uniform loads applied simultaneously for the duration of the test.

The selected test load (both uniformly distributed and concentrated loads) should be appropriate to the type of activity and occupancy of the application. Guidance should be taken from BS EN 1991-1-1 Eurocode 1. Actions on structures.

A load-bearing fire-resistant glass floor may be fully supported along all edges or partially supported on at

Categories	Loaded Area	q _k Uniform load (kN/ m ²)	Q _k Local load (kN)
Category A – Domestic	Floors	1.5 to 2.0	2.0 to 3.0
	Stairs	2.0 to 4.0	2.0 to 4.0
	Balconies	2.5 to 4.0	2.0 to 3.0
Category B	Offices	2.0 to 3.0	1.5 to 4.5
Category C	C1	2.0 to 3.0	3.0 to 4.0
	C2	3.0 to 4.0	2.5 to 7.0 (4.0)
	C3	3.0 to 5.0	4.0 to 7.0
	C4	4.5 to 5.0	3.5 to 7.0
	C5	5.0 to 7.5	3.5 to 4.5
Category D – Shopping areas	D1	4.0 to 5.0	3.5 to 7.0 (4.0)
	D2	4.0 to 5.0	3.5 to 7.0

Extract from BS EN 1991-1-1:2002 - Eurocode 1. Actions on structures. General actions. Densities, self-weight, imposed loads for buildings. Ranges of values—recommended values are underlined

least 2 edges depending on the application and associated specification. In this case the critical dimension for load calculation shall be considered as the shortest span. Therefore, if the span increases the loads that may be applied will reduce, or an alternative specification for the loaded panel should be considered.

Above all, it is important that the service application of the floor is at, or within, the limits of the tested load, as specified in the test report or extended scope assessment from a suitably qualified notified body

4. In service functional requirements

A tested fire-resistant glass floor system combines different glass layers and suitable framing in either steel or timber. As the system heats up, the characteristics of the framing and glass may well change, therefore potentially affecting the ability of the structure to withstand applied loads. This consideration is crucial in a design evaluation of fitness for use in case of fire. The fire-resistant floor system should therefore demonstrate that it can:

- Withstand the concentrated and uniform loads detailed in BS EN 1991-
- 1-1 for the application
- Withstand those loads for the duration of the fire test without failure or significant distortion, as detailed in the applicable test standards
- Resist significant increases in temperature on to the loaded surface

Systems may utilize suitable heat-treated or laminated glass in the upper load-bearing panel, with a lower panel of rated fire-resistant glazing which may require insulation performance (i.e. EI) fire-resistant glass to provide the lowest risk of heat transfer into the structure, thereby limiting the potential risk of heat exposure of sensitive lamination layers within the structure. This lower panel may be bonded by lamination to the loaded panel or separated by an air gap. Suitably tested thermoplastic or thermoset interlayer types in foil or resin form may be acceptable for the lamination of the loaded leaf and the lamination of the loaded leaf to the fire-rated glass. Reference may be made to prEN16612/16613 Structural Glass Eurocode (status dependent).

If toughened glass is used in the load-bearing part of the structure, the recommended best practice is that each toughened glass layer is duplicated by a second adjacent toughened glass layer to ensure sufficient security in the event of failure of one of the toughened glass layers.

It is important that separate consideration be given in design both to connections of the floor structure to the

SECTION 8:

Fire-Resistant Glass Floors

surrounding structure and to the consequential movements that may be transferred. The floor specification may also need to comply with the general requirements for overhead glazing. It is recommended that all toughened glass materials are subject to heat-soak testing.

5. Additional functional considerations

Other key properties need to be considered because of the application. Specifically, this includes slip resistance, the required level of privacy, pattern or obscuration and the acoustic performance of the floor. The floor specification should also comply with the practice for overhead glazing of minimising the risk of falling glass during normal use (i.e. preferably no exposed toughened glass in the underside layer). Where slip resistance is concerned the particular guidance should be obtained from the client to ensure compliance with any health and safety risk assessment that may have been carried out for the

Key specification check list

- Required fire-resistance classification
- Fire-resistance of elements supported by the floor
- The loads to be applied to the system
- The required level of slip resistance
- Acoustic performance and specification
- Internal or external application
- (U-value if applicable)
- Level of privacy and obscuration required
- Fire-resistance of surrounding elements
- Weights of installed floor elements for installation handling assessments
- Conformity to CDM requirements for installation and replacement

application. Note should also be taken of recommendations given in Approved Document B that floorings on escape routes should be chosen to minimise their slipperiness when wet.

The acoustic attenuation performance of the floor may need to be particularly considered to minimise migration of internal noise through the structure between adjacent spaces. Guidance is provided by Approved Document E (Resistance to the passage of sound) to minimise disruption from background noise levels for internal living spaces. A target is given by the AD of at least 45dB for the measured standard differential acoustic factor {DnT,w} between two adjacent enclosed spaces.

6. Systems

Any system considered must have an applicable test report showing test evidence appropriate to the proposed application. Relevant standards – found in section 1 - include BS EN1365-2, BS EN 1363-1, BS EN 12150 (toughened glass), BS EN 1279, BS EN 12543 1-6 and BS EN 14449 (level 1 attestation) since the glass structure normally includes laminated layers. It is recommended that the floor system should be based on CE marked glass with an appropriate certificate of attestation, in accordance with the relevant essential requirements of the Construction Products Regulation, in view of the high performance requirement of the application regarding load-bearing capability under fire conditions.

The framing should be manufactured strictly to the submitted test design with adequate fire protection.

7. Connections and Gaskets

When designing the connection detail the stability of the surrounding system should be confirmed by the client's engineer. The specific connection may be adjusted subject to specific project conditions and fixing regimes must be detailed on the construction drawings submitted for approval.

Gaskets and seals used shall be as per the submitted test design. Fire resistant materials should be provided by an approved manufacturer with relevant test evidence.

8. External load-bearing fire-resistant floors

It may be necessary to install fire-resistant glass floor externally, if this is required it is necessary to also

SECTION 8:

Fire-Resistant Glass Floors

consider the thermal insulation requirements of the Building Regulations. Approved Documents L contain methods of achieving these requirements with calculation methods based on the U-value of the glass. Specifications, supported by calculations, will be required to demonstrate compliance with the Building Regulations. Consideration should also be given to UV stability when exposed to sunlight.

9. Installation

Installation must be carried out by the manufacturer's trained staff or approved installers to the manufacturer's specification.

Documents relating to the construction, its specification and attested fire performance should be submitted on completion in accordance with the requirements of Approved Document B and the Regulatory Reform (Fire Safety) Order (or equivalent in Scotland and Northern Ireland).

Key knowledge checklist

- Requirements to BS EN 1365-2
- Requirements to BS EN 12543-1 to BS EN 12543-6
- Requirements to BS EN 14449
- Requirements to BS 1991-1-1
- Requirements to BS EN 1279 for IG Units
- Slip resistance compliance (reference client's health and safety risk assessment)

SECTION 9:

Replacement of Fire-Resistant Glazing

Section Contents:

1. **Refurbishment of fire-resistant glazed doors and screens**
2. **Replacement glazing in doors, frames or screens manufactured from materials other than timber or steel**
3. **Marking of fire-resistant glass**
4. **Supporting construction**
5. **Maintenance and aftercare**
6. **Fire stopping**
7. **Storage and transport of fire-resistant glass**
8. **Records and documentation**

1. Refurbishment of existing fire-resistant glazed doors and screens**Recommended best practice**

Any refurbishment involving replacement of components must be carried out exactly according to the original specification of the fire-resistant system as installed, providing that the fire risk has not changed. This must be confirmed by the Responsible Person for the building.

The original documentation or building Operations And Maintenance (O&M) Manual provided on installation must be consulted and components must be replaced with the original material as specified. If individual components cannot be replaced with the same components then the complete glazed system must be replaced with an equivalent system.

It should be recognised that it may not be possible to follow the recommended best practice, for a number of valid reasons, such as:

- The required specification may not be available, or may be unclear
- Marking on the glass may be absent or unreadable
- Some of the components may no longer be available
- In some buildings – such as historic and heritage

buildings – current practice and regulations covering fire safety is likely to be different from any which might have applied when the building was constructed

Under these constraints, a practical approach has to be taken and the general guidance given below may help. But this advice should not be regarded as a substitute for first hand guidance on site from a specialist in fire-resistant glazing systems. For this guidance, please contact the appropriate member of the Fire Resistant Glazing Group (see Appendix A).

This route should only be taken when there is no alternative and when the best practice recommendation given above cannot be followed.

Glass

It is very difficult to differentiate between different types of fire-resistant glass when they are glazed. One way is to examine the product stamp which should always be present and visible.

Best Practice Rule No. 9

Any components within a fire-resistant glazed system must be replaced with the same material on a like-for-like basis to avoid compromising the specified fire-resistance performance

If the glass is broken, it may still be possible to identify the manufacturer if the stamp is intact. The specific source of glass is important, as fire test approvals are specific to the particular glazed system and the particular glass, not the generic glass type.

For fire-resistant laminated glass where the stamp is not distinguishable, it may be possible to identify the glass type by examination of the interlayer; but this requires specialist advice from the glass manufacturer.

If the glass cannot be identified via the above methods, seek specialist advice from member of the Fire Resistant Glazing Group (see Appendix A).

Special care should be taken to ensure that standard

SECTION 9:

Replacement of Fire-Resistant Glazing

laminated glass for impact safety purposes - which does not have any resistance against fire – is not confused with fire-resistant laminates.

Timber Doors

It might be possible to identify the fire-resistance period of the door if it carries markings originating from one of the available certification schemes, e.g. CERTIFIRE, BWF CERTIFIRE or the BM TRADA Q Mark.

Contact the responsible certification authority for confirmation, as appropriate.

Glazing Seals

Seals are typically placed between the glass and the bead face on glazing, but some manufacturers use a seal applied around the edge of the glass. This must not be confused with a lining strip which is laid underneath the beads across the full width of the door. In some special applications with elastomeric channels, a lining strip is used even on 30 minute applications, but the bead depth can then serve as an alternative indication of fire performance.

Damaged beads must be replaced with the same timber as used originally, and the section must be the same.

Bead fixings are important and the type and length used originally must be replicated. The manner of fixing (e.g. screws or pins, types and gauge, angle of fixing and fixing centres) must also be replicated as originally designed.

Seals are often untraceable, but some seals may be marked with the seal manufacturer's name but this not always the case. Where there is no indication of the manufacturer of the product, advice should be sought from glass/glazed system or seal manufacturers on a suitable replacement product compatible with the fire-resistant glass.

Steel doors and screens

The ceramic fibre seal must be replaced when replacing the glass, to avoid any sharp debris that could cause the glass to crack when the beads are refitted. The same material must be used as originally

specified and this must be established by contacting either the glass manufacturer or the supplier of the system.

Protected buildings and historical context

The modification of existing historical glazed situations to bring them up to modern fire standards is a specialist area requiring input from a specialist in fire-resistant glazed systems. This can be especially difficult in protected buildings where it is important to preserve the historical style and context of the structure. However, it will generally be possible to make improvements, subject to obtaining this specialist site-specific advice.

It is highly unlikely that the upgrading of an existing door or screen in this context can achieve a fire performance comparable with modern practice.

It may be possible to develop a specific tailor-made solution for the particular situation under consideration.

Best Practice Rule No. 10

The glazing system must be installed in a supporting structure which has a fire rating at least equal to that of the glazing system.

One approach, for example, is to install a complete glazed system – frame, glass, bead, fixings, and seals - as a new unit in conjunction with the existing glazed section.

2. Replacement glazing in fire resistant doors, frames or screens manufactured from materials other than timber or steel

It may be necessary to replace glazing in a fire-resistant building element (door, window, screen etc.) where the framing is manufactured from a material other than timber or steel, such as PVC-u, aluminium or modern composite materials (GRP/ Thermoplastic/Foams/Timber/Engineered timber). These elements are usually supplied to site glazed

SECTION 9:

Replacement of Fire-Resistant Glazing

and should they require re-glazing on site due to damage or breakage, the original manufacturer must be identified and contacted to confirm the exact glazing specification. Re-glazing of the element must be carried to this exact specification to ensure performance in accordance with the original test evidence or assessment.

It is very unlikely that the fire resistance of an existing element can be improved without replacing the element with one designed and tested or assessed to the new required specification. Should an upgraded element be fitted, the supporting structure must be checked to confirm it will also perform to the new requirement.

3. Marking of fire-resistant glass

Fire-resistant glass should carry a permanent mark (for example, of the type normally applied for impact safety). This mark must show as a minimum the glass product name, supplier and safety impact rating if required. In some cases, additional information such as the fire performance classification for the glass may also be given.

Any identifying marks on the glass must be visible and legible after glazing. The important reasons for marking the glass in this way are as follows:

- Confirmation and ready cross-checking against building specification that the specified glass has been installed
- Information for those carrying out fire risk assessments
- Notification of the glass type and manufacturer in case replacement is necessary.

Marking with the name of the particular glass product that has been installed is particularly important for non-reinforced fire-resistant glass types since they cannot be individually identified when glazed without such a mark (for example, modified toughened soda lime glass or borosilicate).

Such an identifying mark on the glass must not be assumed to be applicable to the whole of the glazed system. There must be appropriate performance

evidence for the system as a whole, and the fire-resistant glass must be approved as an integral part of that system. Reference to this evidence must be given in the documentation provided on installation.

Best Practice Rule No. 11

It is always important to seal the gap between the frames and supporting structure without compromising any expansion for the assembly as a whole

The mark on the glass should therefore be taken as only an indicator for the system as a whole. Confirmation that a suitable system has been installed, and the rating of that system, must be available in accompanying documentation.

4. Supporting construction

The supporting construction into which the framed assembly is to be fitted must be checked to make sure that it is satisfactory to take the fire-resistant glazed element.

Important checks are that:

- The opening is correctly sized and prepared so that the frame fits within defined tolerances
- The correct expansion allowance is provided
- The supporting structure is strong enough to withstand any forces generated by the glazed element in a fire
- The types of fixings are suitable for the supporting substrate, and sufficiently fire-resistant
- The fixings are capable of supporting the weight of the fire-resistant glazed assembly
- The supporting structure is sound and robust
- Any shims used to position the framed assembly in the supporting construction do not interfere with the required expansion of the assembly in a fire situation

SECTION 9:

Replacement of Fire-Resistant Glazing

Supplier's installation instructions must be followed at all times.

The type of supporting structure must be the same as that tested, or assessed. For example, a test in a rigid supporting structure does not necessarily and automatically cover fixing to a flexible supporting structure, and vice versa.

5. Maintenance and aftercare

Special maintenance procedures are not required. However, regular visual inspection of fire-resistant glazing should be carried out as part of the fire safety risk assessment routine for the building to ensure that the original fire-resistant glazed installations have not been damaged, either maliciously or during normal building use.

This inspection as a minimum should examine:

- The presence of any significant cracks, scratches or surface damage on the glass (which is particularly important for modified soda-lime silicate toughened glass and borosilicates since surface damage can dramatically affect fire and impact performance of this type of fire-resistant glazing)
- The gaskets, glazing strips, mastics, or seals around the glass for signs of significant deterioration, damage or missing sections (including any hot or cold smoke seals)
- The intumescent seals fitted to the top and sides of fire doors to ensure that they are in the correct position, not significantly damaged or have missing sections
- The beads and bead fixings, to ensure that the bead is securely held in place
- The frame sections to ensure that they are fixed securely and not working loose
- Door hinges, mechanical closers, handles, locks and other parts of door hardware to ensure that they are functioning as intended

Should the inspection raise any major concerns about the condition of the fire doors or screens which could impair fire performance then a full overhaul should be instigated as soon as practical. This may require either repair or replacement.

6. Fire stopping

Where the gaps are to allow for expansion they must be sealed as directed, but care must be taken to ensure that a flexible and non-combustible backing material is used rather than a rigid one.

If no expansion allowance is specified then fire stopping may be carried out using non-combustible and temperature-resistant materials such as board, medium-density mineral fibre, intumescent or non-intumescent seals, subject to installation instructions.

7. Storage and transport of fire-resistant glass

All reputable manufacturers will supply guidance on handling, storage and transport for their proprietary fire-resistant glass products. These recommendations must always be followed.

In all cases, the necessary glass handling or lifting equipment must be used.

The standard practice for storing glass must be followed: it must be kept dry and protected against the weather, and properly stacked on suitable stillages to avoid edge damage and breakage. The stillages should also be stored for easy access and handling.

8. Records and documentation

- It is the contractor's responsibility to ensure that adequate documentation and confirmation of the installed fire-resistant system are provided. This documentation normally includes the following at different stages:
- On submitting a tender, full specification and description of the system that would be provided
- On confirming an order, a method statement and

SECTION 9:

Replacement of Fire-Resistant Glazing

risk assessment

- After installation, an operation and maintenance manual which confirms the work completed.

A suitable operation and maintenance manual normally provides the following, as a minimum:

- A drawing of the system as installed together with a description of main features and dimensions
- Test and commissioning certificates which include evidence of fire performance clearly referenced to relevant test evidence
- Confirmation of suppliers and a listing of main components by name
- Advice on maintenance requirements and actions for damage repair

Certification from third party schemes, or manufacturer's information on applicable

CE Marking, may also be provided, if available.

Reports of post-installation inspections must also be noted, as appropriate, and a record kept of any replacements, lodged with the appropriate Responsible Person (under appropriate legislation).

SECTION 10:

Upgrading

Section contents:

1. Introduction
2. Structure
3. Timber frames
4. Timber glazing beads
5. Steel frames
6. Glazing seals
7. Glass
8. Glazing

1. Introduction

The performance of fire resistant glazing is determined by reference to either the BS 476 fire tests, or BS EN 1364 for walls and BS EN 1634 for doors.

However, in certain applications and situations, it may not be possible to demonstrate the suitability of upgrading existing glazing or potential refurbishment of existing glazing by way of primary fire test evidence.

Such situations include, Grade 1, 11 and 11* listed buildings, buildings of historical interest, lack of resources, change of use. In these situations, the building owner or occupier may decide to take a risk assessment-type approach to the refurbishment of existing glazing. It must be pointed out, that this type of approach often carries substantial risk, and careful consideration of all the facts should be taken before undertaking any such work. The Regulatory Reform (Fire Safety) Order 2005, places the responsibility on building owners and occupiers with respect to ensuring the fire safety to all those using, visiting or living within their buildings.

In taking a risk-based approach, it is important to remember that the entire area where the glazing is situated must be robust. Whilst the fire resisting glass is the area that most people consider, it can only perform its function if the whole supporting structure and essential components used with the glass, are

equal to its potential fire performance.

Therefore, the supporting wall or partition must be fire resisting, the frames, glazing beads, glass, glazing method, and the frame to structure seal must all be compatible, and capable of providing the necessary level of fire performance. Simply removing a sheet of non-fire resistant glass from an existing frame and replacing it with a piece of fire resisting glass, will not provide a barrier to fire.

Best practice is for a third party approved body to produce an assessment as defined in section 2 of this guide.

The purpose of this section of the guide is to provide some practical considerations and advice to anyone involved in the refurbishment of glazing that is required to provide fire resistance.

2. Structure

Any wall or supporting structure should be capable of providing the required level of fire performance such as 30, 60, 90 or 120 minutes. The structure must also be able to support the weight of any glazing.

Guidance on fire resistance of concrete masonry can be found in BS 5628 -3. Guidance relating to non-load bearing partitions can be found in the ASFP Publication - The Purple Book.

The clearance gaps between the frame and structure must be fire stopped using a suitable material such as, an intumescent sealant or mastic that has shown by fire test to provide fire resistance in this application. A compatible sealant should be used suitable for the size of gap and compatible with the surrounding structure.

3. Timber Frames

Section 5 of this guide discusses the use of timber screens and doors. Timber chars, and can ultimately continuously flame, when subjected to the full effects of a fire. The type of timber, its density, grain structure and its size will determine how quickly these conditions occur.

Hardwood timbers with a density > 630 kg/m³ will

SECTION 10:

Upgrading

char at 0.5mm per minute and softwood timbers with a density > 480 kg/m³ will char at approximately 0.7mm per minute. However, there are exceptions to this rule such as Ash and Douglas Fir as they char quicker than their respective densities suggest.

Before undertaking the glazing of an existing timber frame, the following guidance should be considered.

- Where possible, identify the timber species.
- Ensure the frame is soundly fitted to the supporting structure.
- Measure the width and depth of the main frame.
- Check the condition of the frame. In particular look for damage or splits within the timber. If there is substantial damage or large splits, then it must be assumed the frame is not fit for purpose and should be replaced.
- If the frame is in good condition, then the following Best Practice guidance could be applied.
- 30 minutes integrity and insulation - minimum size 100mm x 50mm
- 60 minutes integrity and insulation - minimum size 130mm x 50mm
- > 60 minutes - timber frames will not, as a general rule, be capable of providing fire resistance for fire resistance periods greater than 60 minutes.

N.B. Sash and opening windows have not been proven to provide fire resistance, even when glazed with fire resisting glass.

3. Timber Glazing Beads

The same conditions referenced above in respect of species, size etc. also apply to glazing beads. Further consideration has to be given to, the shape of glazing beads. Basic guidance is given below.

- Where possible, identify the timber species.
- Measure the width and depth of the glazing beads
- Measure/calculate any chamfer that may be present on the glazing beads
- Check the condition of the beads. In particular

look for damage or splits within the timber. If there is substantial damage or large splits, it must be assumed the beads are not fit for purpose and should be replaced.

- If the beads are in good condition, then the following Best Practice guidance could be applied.
- 30 minutes integrity - minimum size 15mm high x 35mm deep with chamfer of between 10 - 15 degrees away from the glass face.
- 30 minutes integrity and insulation - minimum size of 15mm high x 40mm deep. Beads can have a chamfer as above or rectangular.
- 60 minutes integrity - minimum size 25mm high x 40mm deep with a chamfer of 20 degrees away from the glass face.
- 60 minutes integrity and insulation - minimum 20mm high x 40mm deep. Beads can have a chamfer as above or rectangular

4. Steel Frames

Section 6 of this guide discusses the use of steel screens and doors. Steel expands when subjected to the effects of a fully developed fire, and this expansion can cause fracture (thermally or mechanically induced) if the glazing system is not designed to allow for this.

Steel glazing systems that have been specifically designed for fire resistance, take all these factors into consideration. Where situations arise as detailed in paragraph 3 above, then the following guidance is given.

Before undertaking the glazing of an existing steel frame, the following guidance should be considered.

- Ensure the frame is securely fitted to the supporting structure.
- Measure the width and depth of the main frame.
- Check the condition of the frame. In particular look for damage, or distortion within the frames or glazing beads. If there is damage, then it must be assumed the frame is not fit for purpose and should be replaced.

SECTION 10:

Upgrading

- Only fire rated aluminium frames that have been tested or certificated may be glazed with fire resisting glass, which has been shown to be compatible with the specific frame type. The frame will not provide any fire resistance.

If the frame is in good condition, then the following Best Practice guidance could be applied.

Integrity Only

- The frame must be well secured to the surrounding structure using mechanical fixings.
- The glazing beads need to be applied to securely fix to the main frame.
- The glass and glazing system must have proven primary fire test evidence, of being glazed into steel frames. Maximum glass sizes and areas must not exceed those tested. The glazing details must follow that tested and not deviated in any way.
- For suitable glass and glazing systems, consult the manufacturers listed in Section 3 and 4 of this guide.
- The glazing rebate must be clean, free of dirt, grit and any other aggressive particles.
- Non-combustible glazing blocks must be used.
- Glass edge cover must be strictly observed. The test evidence should detail this, but if in doubt consult with the glass or glazing system manufacturer.
- Some systems may require capping after the glazing is installed. Always use the sealant specified by the glass/glazing system manufacturer.

Integrity and Insulation

The main frame must be insulating. These frames are generally constructed from two frames bonded with an insulating material between them. For upgraded frames this may not be possible. In which case, a replacement of the complete system may be required.

- The glass and glazing system must have proven primary fire test evidence, of being glazed into

steel frames. The system will have been tested and achieved both fire integrity and insulation as defined in BS 476 Part 22. Maximum glass sizes and areas must not exceed those tested. The glazing details must follow that tested and not deviated in any way.

- For suitable glass and glazing systems, consult the manufacturers listed in Section 3 and 4 of this guide.
- The glazing rebate must be clean, free of dirt, grit and any other aggressive particles.
- Non-combustible glazing blocks must be used.
- Glass edge cover must be strictly observed. The test evidence should detail this, but if in doubt consult with the glass or glazing system manufacturer.
- Some systems may require capping after the glazing is installed. Always use the sealant specified by the glass/glazing system manufacturer.
- If the screen is multi-paned with transoms and or mullions, check that the glass and glazing system have been fire tested/assessed in this application.
- In critical locations, the glass must be classified as a safety glass in respect of impact, as referenced in EN 12600
- Fire-resistant glass must be permanently marked, this marking should be visible, so any inspecting authority can see the name/make of the glass plus any other relevant marks such as a CE Mark.
- The glass may have to provide containment or barrier loading as referenced in BS 6180.
- Thermal expansion allowances (which may be glass - type specific). See Section 3.
- N.B. Existing sash and opening windows have not been proven to provide fire resistance, even when glazed with fire resisting glass.

SECTION 10:

Upgrading

If the fire risk has changed then a complete new fire-resistant glazed system may have to be installed to meet the latest requirements. In this case, the installer must confirm the requirements for fire safety in the building concerned with the Responsible Person, as defined under applicable legislation. The installer must also provide the appropriate test evidence of performance to suit the proposed.

6. Glazing Seals

Normal glazing seals should not be used to glaze fire resisting glass. When selecting a suitable glazing system, the following should be considered and checked.

- The seal has been fire tested/third-party assessed into the relevant frame
- The seal has been fire tested/assessed in conjunction with the glass being used
- The seal manufactures fixing/installation instructions should be followed
- For further guidance see section 4 of this guide

7. Glass

Section 3 of this guide discusses glass type in great detail, and the considerations that must be given when specifying of using fire resistant glass. In respect of this section, the following guidance should be considered.

- The fire resistance required (30 or 60 minutes)?
- Is integrity-only or integrity and insulation required?
- Check that the glass been fire tested/assessed into the relevant frame
- Check that the glass been fire tested/assessed into the relevant frame in the sizes required on site
- If the screen is multi-paned with transoms and or mullions, check that the glass and glazing system have been fire tested/assessed in this application
- The glass together with the glazing seal have been fire tested/assessed together in the relevant

screen

- In critical areas, the glass must be classified as a safety glass in respect of human impact, and referenced in accordance with EN 12600 and the relevant product standard
- The glass may have to provide containment or barrier loading as referenced in Approved Document K (England); Approved Document K (Wales); Building (Scotland) Regulations 2017; Technical Booklet H (Northern Ireland)

8. Glazing

Glazing good practice must be followed at all times. In particular, the following glazing and installation guidance should be followed and observed.

- Frames must be clean and free of any dirt and grit
- Thermal expansion allowances (which may be glass - type specific). See Section 3
- Application of location and setting blocks
- Glaze the glass and glazing seals in accordance with the manufacturer's instructions.
- Ensure the correct edge cover conditions of the glass and glazing system are observed.
- If the glass is permanently marked, these marking should be visible so any inspecting authority can see the name/make of the glass plus any other relevant marks such as the EN 12600 safety performance
- Apply silicone capping seal, where required, in addition to the fire resistant glazing seals

SECTION 11:

Frequently Asked Questions

Q1 Where must fire-resistant glass be used?

A1 Fire-resistant glass is normally used to prevent fire spread and to provide a safe escape route and safe access for firefighters. The national documents providing guidance on how to meet Building Regulations (e.g. Approved Document B for England and Wales) show where fire-resistant barriers are required. If an alternative approach has been taken to demonstrate compliance with Building Regulations, such as a fire safety engineering design study, then the applications for fire-resistant glass must be specified in the appropriate design report. Reference BS 9999 (residential and commercial) Ref RRO 2005

Section 1**Q2 Can I use fire resistant glass in any glazing system and provide the required fire performance?**

A2 No, fire resistant glass is part of a tested system including glass, frame, seals, fixings. It must always be fitted into a frame that has the appropriate test evidence, using the glazing seals and bead types that are approved for that particular glazed system. Competent persons who have the relevant specialist knowledge must always carry out the installation of the glazed system, according to the construction and components given in the accompanying evidence of performance. The wall or supporting structure must also be considered as part of an appropriately approved glazed system.

Q3 What is the difference between integrity (E) and integrity/insulation (EI) glass and when should they be used?

A3 Integrity (E) fire resisting screens and doors prevent the passage of flames and hot gases; integrity and insulation (EI) fire resisting screens and doors restrict the temperature rise of the unexposed face to below specified levels. The areas of application for integrity-only or integrity and insulation performance are given in the appropriate guidance to the Regulations, or in the appropriate design report if the building is subject to a fire safety engineering study.

Section 1**Q4 How can it be ensured that the specified system is appropriate for the application?**

A4 The specified glazed system must have appropriate evidence of performance based on appropriate test information. This evidence may be provided either in a test report, an assessment report by a third party, or by third-party certification. The test evidence that is provided must be appropriate to both the application and the specific glazed system that is to be installed. **Section 2**

Q5 Is it possible to obtain a fire certificate for installed fire-resistant glass products?

A5 There is no such document as a fire certificate. Under RRO fire certificates were phased out during 2006 and now the Responsible Person, i.e. the building or business owner, is responsible for ensuring that appropriate fire precautions and safety measures are in place. Product certificates may be referred to in the context of third-party certification schemes, but these are voluntary and not obligatory. The appropriate evidence of performance for a fire-resistant glazed system can be a fire test or an assessment report, or part of a third-party certification scheme (e.g. Certifire, BWF – Certifire, QMark) which must be provided by the supplier on request.

Section 2**Q6 Why can't standard toughened glass be used for fire-resistant applications?**

A6 Standard toughened glass is not able to withstand the thermal shock generated during a fire and it must not be used where fire-resistant barriers are required. There are a number of specially modified toughened soda-lime glass types available for fire-resistant applications in very specific framing systems, or special glass compositions such as toughened borosilicate glasses that can be used, but all types are strictly subject to manufacturers' specific guidance on their use. **Section 3**

Q7 Can it be assumed that a fire-resistant glass successfully tested in single glazing will give the same performance in an IGU?

A7 No, and never make assumptions. In all cases,

SECTION 11:

Frequently Asked Questions

appropriate proof of performance must be available related to appropriate test evidence. **Section 3**

Q8 What is the largest pane size that can be used?

A8 The pane size will vary according to the glass and framing system, always subject to the availability of appropriate test evidence. In all cases, contact the glass manufacturer or supplier for the maximum glass sizes tested and the associated framing system details. **Section 3 and Appendix A for a listing of glass manufacturers & suppliers.**

Q9 What edge cover should I use when glazing fire-resistant glass?

A9 Different glass types will require different amounts of edge cover according to their individual requirements. Manufacturers/suppliers will provide appropriate guidance, which must be followed. Modified toughened soda-lime glasses are particularly sensitive to edge cover which is generally a maximum of 10mm cover. If the edge cover is too great for this type of glass then premature failure is far more likely. **Section 3 and Appendix A for a list of glass manufacturers and suppliers.**

Q10 When glazing, must I allow for expansion of the fire-resistant glass and frame?

A10 Yes. The glass/frame manufacturer/supplier will define expansion allowance required. **Section 3**

Q11 Can standard PVB laminated safety glass be used for fire-resistant applications, as it is a safety glass?

A11 No. Standard PVB laminated safety glass does not have any fire-resistant properties and it must not be used in fire-resistant applications. Safety glass types with fire-resistant properties are available, based upon special interlayers. **Section 3**

Q12 Can the maximum pane size be increased beyond what was tested?

A12 In some circumstances, yes, but only limited increases in tested pane sizes are allowed, according to third party assessment. The evidence provided by the glass manufacturer/supplier will provide the

maximum pane size for each particular system. **Section 2**

Q13 Can the pane height be increased while reducing the width, keeping the same area?

A13 This is only possible if there is test evidence that the modified dimension meets the fire-resistance performance. Details will be made available by the glass manufacturer/supplier and must be within the scope or subject to a third-party assessment/certification. **Section 2**

Q14 What size and shape of glazing bead can be used?

A14 This information can only be identified by reference to the approved glazing systems, and the size of bead will vary according to the glass and system chosen. **Section 5 and Appendix A.**

Q15 Can the tested gasket or seal be exchanged for an alternative?

A15 This may be possible but only if the alternative has documented evidence showing that it can be used with the glass and framing system. If this evidence is not available, contact the gasket or seal supplier for confirmation of acceptability. **Section 4**

Q16 What glazing seals must be used?

A16 The glazing seal has to be appropriate for the chosen system based on test evidence scope or subject to a third-party assessment/certification. **Section 4**

Q17 How big a piece of glass can be installed into a timber fire door leaf?

A17 This depends on the door leaf being used, as each door manufacturer will have tested different sizes of glass with their door leaf types. Maximum glass size can also depend on the glazing system being used in the door. The test or assessment information for the specific door leaf and glazed system will dictate the allowable maximum glass size and glass aspect ratio. It should be noted, that great care needs to be taken when cutting apertures into door leaves because this can adversely affect the fire-resistance performance of

SECTION 11:

Frequently Asked Questions

the door and this must only be done according to the door manufacturer's guidance and instruction. Impact safety may also limit maximum glass size, as defined in BS 6262-4. **Section 2 and Appendix B**

Q18 What shapes of vision panel can be used in a timber door leaf?

A18 Various shapes are possible, but the types and sizes will depend upon the evidence available for the door leaf and the glazing system. If the evidence is unavailable for the required shape, then the shape must not be used. It should be noted that great care needs to be taken when cutting apertures into door leaves because this can adversely affect the fire-resistance performance of the door. **Section 2**

Q19 What happens if a different species of timber is used?

A19 Different timbers have different burning characteristics and can influence the performance of the door or framing system. An alternative timber should not be used unless there is appropriate fire test evidence. **Section 5**

Q20 What is the minimum frame section that may be used in a timber glazed system?

A20 The minimum section will be the size that can be demonstrated to work with the chosen fire-resistant glass. This can be identified by reference to fire test report. Contact the glass manufacturer/supplier for the appropriate information. **Section 5 and Appendix A**

Q21 Can square timber beads be used for fire-resistant glazing?

A21 Yes, in certain cases. For insulation glass types, in particular, square beads present few problems but integrity-only glass types require more detailed consideration as transferred heat can lead to bead ignition on the protected face. Partial insulation glass types may also allow the use of square beads, subject to appropriate evidence of performance based on tests. **Section 5**

Q22 Can fire-resistant glass be installed into metal frames?

A22 Steel and aluminium framing systems may be used but only if the frame is specifically designed as part of an approved fire-resistant glazed system. Standard steel or aluminium framing systems are not suitable for fire-resistant applications. **Section 6**

Q23 Can fire-resistant glass be installed into frameless systems?

A23 Yes. There are butt-jointed glazed options with the glass supported in a peripheral frame and bolted systems with the glass drilled and fixed to a supporting structure. These systems have the appropriate fire test evidence and the glass manufacturer/supplier should supply the appropriate information. **Section 7 and Appendix A**

Q24 Is it possible to have glass supplied for installers to fit within their own frames?

A24 All glass types are available on a supply-only basis but it must always be fitted into a frame that has the appropriate test evidence, using the glazing seals and bead types that are approved for that particular glazed system. Competent persons who have the relevant specialist knowledge must always carry out the installation of the glazed system, according to the construction and components given in the accompanying evidence of performance. Fire-resistant glass must only be used as part of an appropriately approved glazed system. **Section 9**

Q25 The glass in an existing aperture must be replaced, can a suitable glass be supplied?

A25 All fire-resistant glass types may be used in refurbishment glazing but the glass and seals must be replaced on a like-for-like basis in the existing frame according to the original evidence of performance provided for the particular glazed system as installed. When carrying out any replacement glazing, the frame must be checked to ensure that it is in a suitable condition for re-glazing to be carried out. In all cases, the replacement must be an approved fire-resistant glazed system with appropriate evidence of performance, and the performance rating of that system must be appropriate to the latest guidelines, for example as given in the latest version of Approved

SECTION 11:

Frequently Asked Questions

Document B (England). If there is any uncertainty about any of the components that have to be replaced, or uncertainty about the performance rating that is required, expert guidance must be sought from a member of the GGF's Fire Resistant Glazing Group.

Section 9

Q26 Can I refurbish a fire-resisting screen?

A26 There are techniques available to refurbish an existing fire-resistant screen. Please refer to section 10 of this guide for additional information. **Section 10**

Q27 Can MDF be used as part of a fire-resistant glazed system?

A27 Yes, provided there is appropriate test evidence or an assessment report, or a third-party certification scheme (e.g. Certifire, QMark) covering MDF in a particular frame type. **Various sections**

APPENDIX A:

Membership of the Fire-Resistant Glazing Group

Fire Resistant-Glazing Group (FRGG)

Details of GGF members of the FRGG can be obtained from:

Glass and Glazing Federation,
40 Rushworth Street
London,
SE1 0RB

Tel: 0207 - 939 - 9101

Email: info@ggf.org.uk

Website: www.ggf.org.uk

Visit our website for details of manufacturers, suppliers and installers of fire-resistant glass

FRGG members who have assisted with the revision of this Best Practice Guide:

AGC

Promat UK Ltd

Hodgson Sealants Ltd

Pilkington UK Ltd

Vetrotech Saint-Gobain UK

Mann McGowan Fabrications Ltd

Schott UK Ltd

Dixon International Group Ltd

Exova Warringtonfire

Pyroguard

Arkoni Ltd

Hulin Associates

Ceramic Glass Ltd

Koemmerling Chemische Fabrik GMBH

ANNEX B:

Summary of Impact Safety Requirements

Building Regulations:

- England - Approved Document K
- Wales – Part N
- Scotland - Section 4 – Safety
- Northern Ireland - Technical booklet V

The following requirements must also be considered

- Workplace health, safety and welfare. Workplace (Health, Safety and Welfare)
- Regulations 1992.


- The consumer protection Act 2009
- The General Product Safety Regulations 2005

Figure B1 illustrates the areas most commonly requiring safety glass to be installed.

Glazing should comply to BS 6262-4, with a suitable glass marking incorporating the company trade name, product standard, EN 12600 impact classification, and fire performance.

Note: Areas of glass less than 0.5m² or less and a minor dimension of 250mm or less, may be glazed with annealed glass with a minimum thickness of 6mm except in the case of traditional leaded lights or copper lights.

Key	
Doors and side panels over 900mm	Not less than EN 12600 Class 2
Doors and side panels up to 900mm	Not less than EN 12000 Class 3
Low level glazing	Not less than EN 12600 Class 3

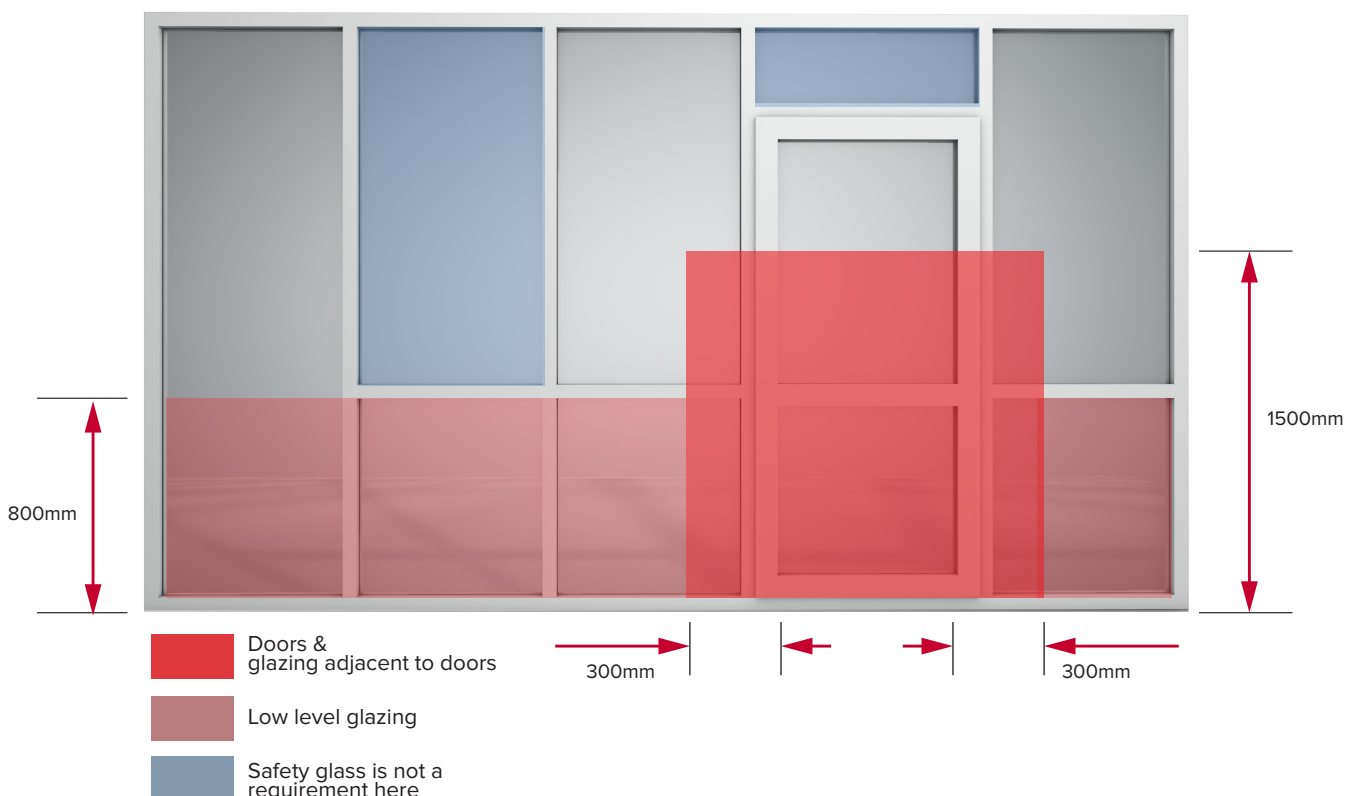

ANNEX B:

Summary of Impact Safety Requirements

Table B1—Glass classification in accordance with BS EN 12600

Location	Pane Dimension	Glass Classification BS EN 12600
Door or door side panel	Minor dimension > 900mm	Class 2
	Minor dimension < 900mm	Class 3
	Minor dimension < 250mm with an area <0.5m ²	No classification required. Minimum 6mm annealed, except lead and copper lights
Low level glazing	Minor dimension < 900mm	Class 3
	Minor dimension < 250mm with an area <0.5m ²	No classification required. Minimum 6mm annealed, except lead and copper light

Table B1 - Additional information on safety glazing can be found in the GGF publication "The right glazing in the right place".

Other Building Regulations relating to glass

In some applications, fire-resistant glass may be required to provide.

For example, where it protects a difference in adjacent levels greater than 600mm in dwellings and 380mm in buildings other than dwellings, the glass should be designed as a barrier. Glass wholly or partially below the minimum barrier height

should be in accordance with the recommendations in BS 6262-4 (see note 2) and be designed to satisfactorily withstand the given design loads:

- Horizontal uniformly distributed line load (often referred to as line load), applied at the design level, usually 1100mm from finished floor level
- Uniformly distributed load, applied to the infill (often referred to as infill UDL)
- Point (or concentrated) load, applied to part of the infill

(Table 1 of BS 6180 Table 1 gives minimum barrier heights)

Guidance on the suitability of a particular fire-resistant glass as a barrier should be obtained from the

manufacturer or supplier. Installing an appropriate handrail at 1100mm from finished floor level may not necessarily be sufficient to

avoid the application of all of the barrier loads to the glass.

ANNEX C:

Requirements of Glazing Manifestation

If there is a risk that people could come into contact with large, uninterrupted areas of transparent glazing whilst moving in and about a building, features which make the glazing apparent should be used.

This is called manifestation, and it may take the form of patterns, company logos, broken or solid lines, etc marked on the glass at appropriately defined heights and intervals.

In Building Regulations and standards, manifestation on glass is required at two heights:


- 850mm to 1000mm and 1400mm to 1600mm above floor level

Manifestation must contrast visually with the background seen through the glass, in both directions

in all lighting conditions. It may take the form of a logo at least 150mm high, or a decorative feature, such as broken lines or continuous bands at least 50mm high. Glazed entrance doors that are adjacent to, or part of, a glazed screen, are clearly differentiated from the screen by a high contrast strip at the top and both sides.

Manifestation applies especially to defined critical locations, such as internal or external walls of shops, showrooms, offices, factories, public or other non-domestic buildings where there are likely to be groups, or moving streams, of people in the vicinity of the glazing.

Examples of door height glazing not warranting manifestation

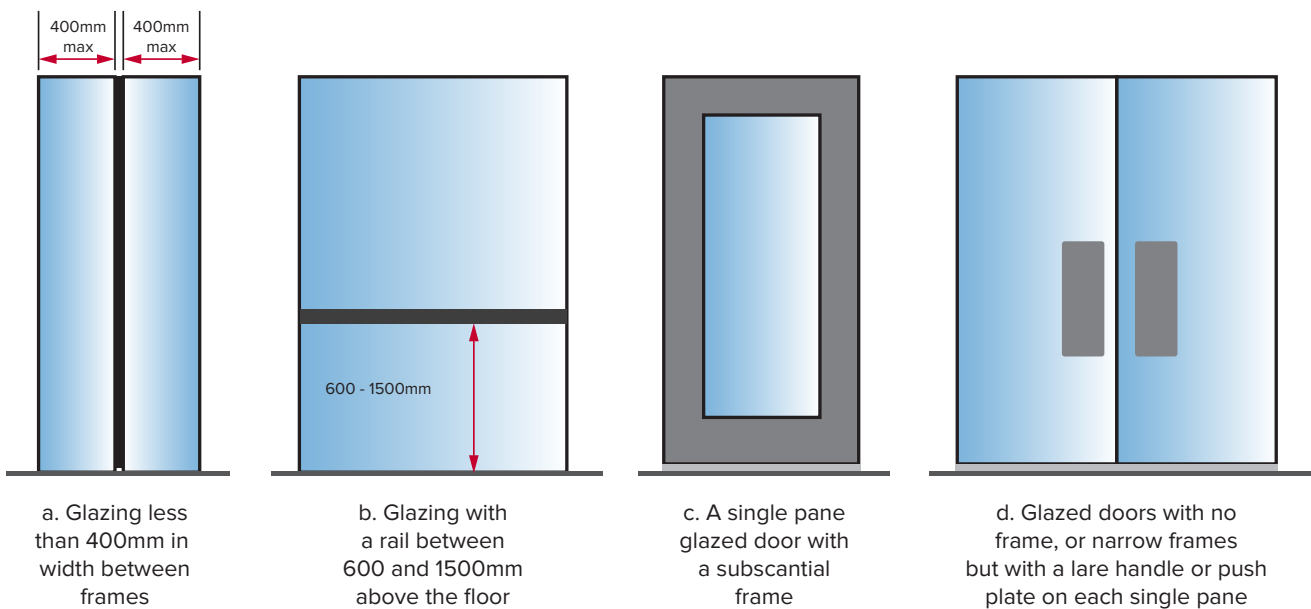

ANNEX D:

Contact details of Associated Organisations

Architectural and Specialist Door Manufacturers Association (ASDMA)

Burnside House
3 Coates Lane
High Wycombe
Buckinghamshire
HP13 5EY

Tel: 01494 447370
www.asdma.com

Association for Specialist Fire Protection (ASFP)

Kingsley House, Ganders Business Park
Kingsley
Bordon
Hampshire
GU35 9LU

Tel: 01420 471 612
www.asfp.org.uk
E-mail: info@asfp.org.uk

British Woodworking Federation (BWF)

The Building Centre
26 Store Street
London
WC1E 7BT

Tel: 0844 209 2610
Fax: 0844 209 2611
www.bwf.org.uk
E-mail: bwf@bwf.org.uk

Centre for Window and Cladding Technology (CWCT)

The Studio
Entry Hill
Bath
BA2 5LY

Tel: 01225 330 945
www.cwct.co.uk
E-mail: cwct@cwct.co.uk

Construction Products Association (CPA)

The Building Centre
26 Store Street
London

WC1E 7BT

Tel: 0207 323 3770
www.constructionproducts.org.uk
E-mail: jeff.may@constructionproducts.org.uk

Finishes and Interiors Sector (FIS)

Olton Bridge
245 Warwick Road
Solihull
West Midlands
B92 7AH

Tel: 0121 707 0077
www.thefis.org
E-mail: info@thefis.org

Fire Door Inspection Scheme (FDIS)

The Building Centre
26 Store Street
London
WC1E 7BT

Tel: 0844 801 1518
www.fdis.co.uk
E-mail: info@fdis.co.uk

Fire Sector Federation

London Road
Moreton-in-Marsh
Gloucestershire
GL56 0RH

Tel: 01608 812 543
www.firesectorfederation.co.uk
E-mail: admin@firesectorfederation.co.uk

The Guild of Architectural Ironmongers (GAI)

BPF House
6 Bath Place
Rivington Street
London
EC2A 3JE

Tel: 0207 033 2480
www.gai.org.uk
E-mail: info@gai.org.uk

ANNEX D:

Contact details of Associated Organisations

Passive Fire Protection Federation (PFPF)

Kingsley House, Ganders Business Park
Kingsley
Bordon
Hampshire
GU35 9LU

Tel: 01420 471 621

Fax: 01252 471 611

www.pfpf.org

E-mail: admin@pfpf.org

Steel Window Association

Unit 2, Temple Place
247 The Broadway
London
SW19 1SD

Tel: 0208 543 2841

www.steel-window-association.co.uk

E-mail: info@steel-window-association.co.uk

This best practice guide is produced by the Glass and Glazing Federation (GGF) and is issued for guidance only. The GGF accepts no responsibility for reliance on any advice given, for any omissions from the guide or for the consequences of users acting in accordance with contents of the guide. Whilst every attempt is made to present up-to-date information and accurate guidance, any liability on the part of the GGF arising in connection, interpretation or application of this guide is expressly disclaimed.

Proprietary product names referred to in the guide are those produced or supplied by members of the Fire Resistant Glazing Group of the GGF. This is not to imply that products from non-members are unsuitable for use in fire-resistant glazed systems. Such products may be suitable, always conditional upon the availability of appropriate evidence of performance and/or compliance founded on relevant test information.

Glass and Glazing Federation
40 Rushworth Street
London
SE1 0RB

T: 020 7939 9100
E: info@ggf.org.uk
www.ggf.org.uk
Follow us on Twitter: [@GGF_News](https://twitter.com/GGF_News)

